


Figure 6-1, PCE Concentrations in Wells with Detections above the MCL

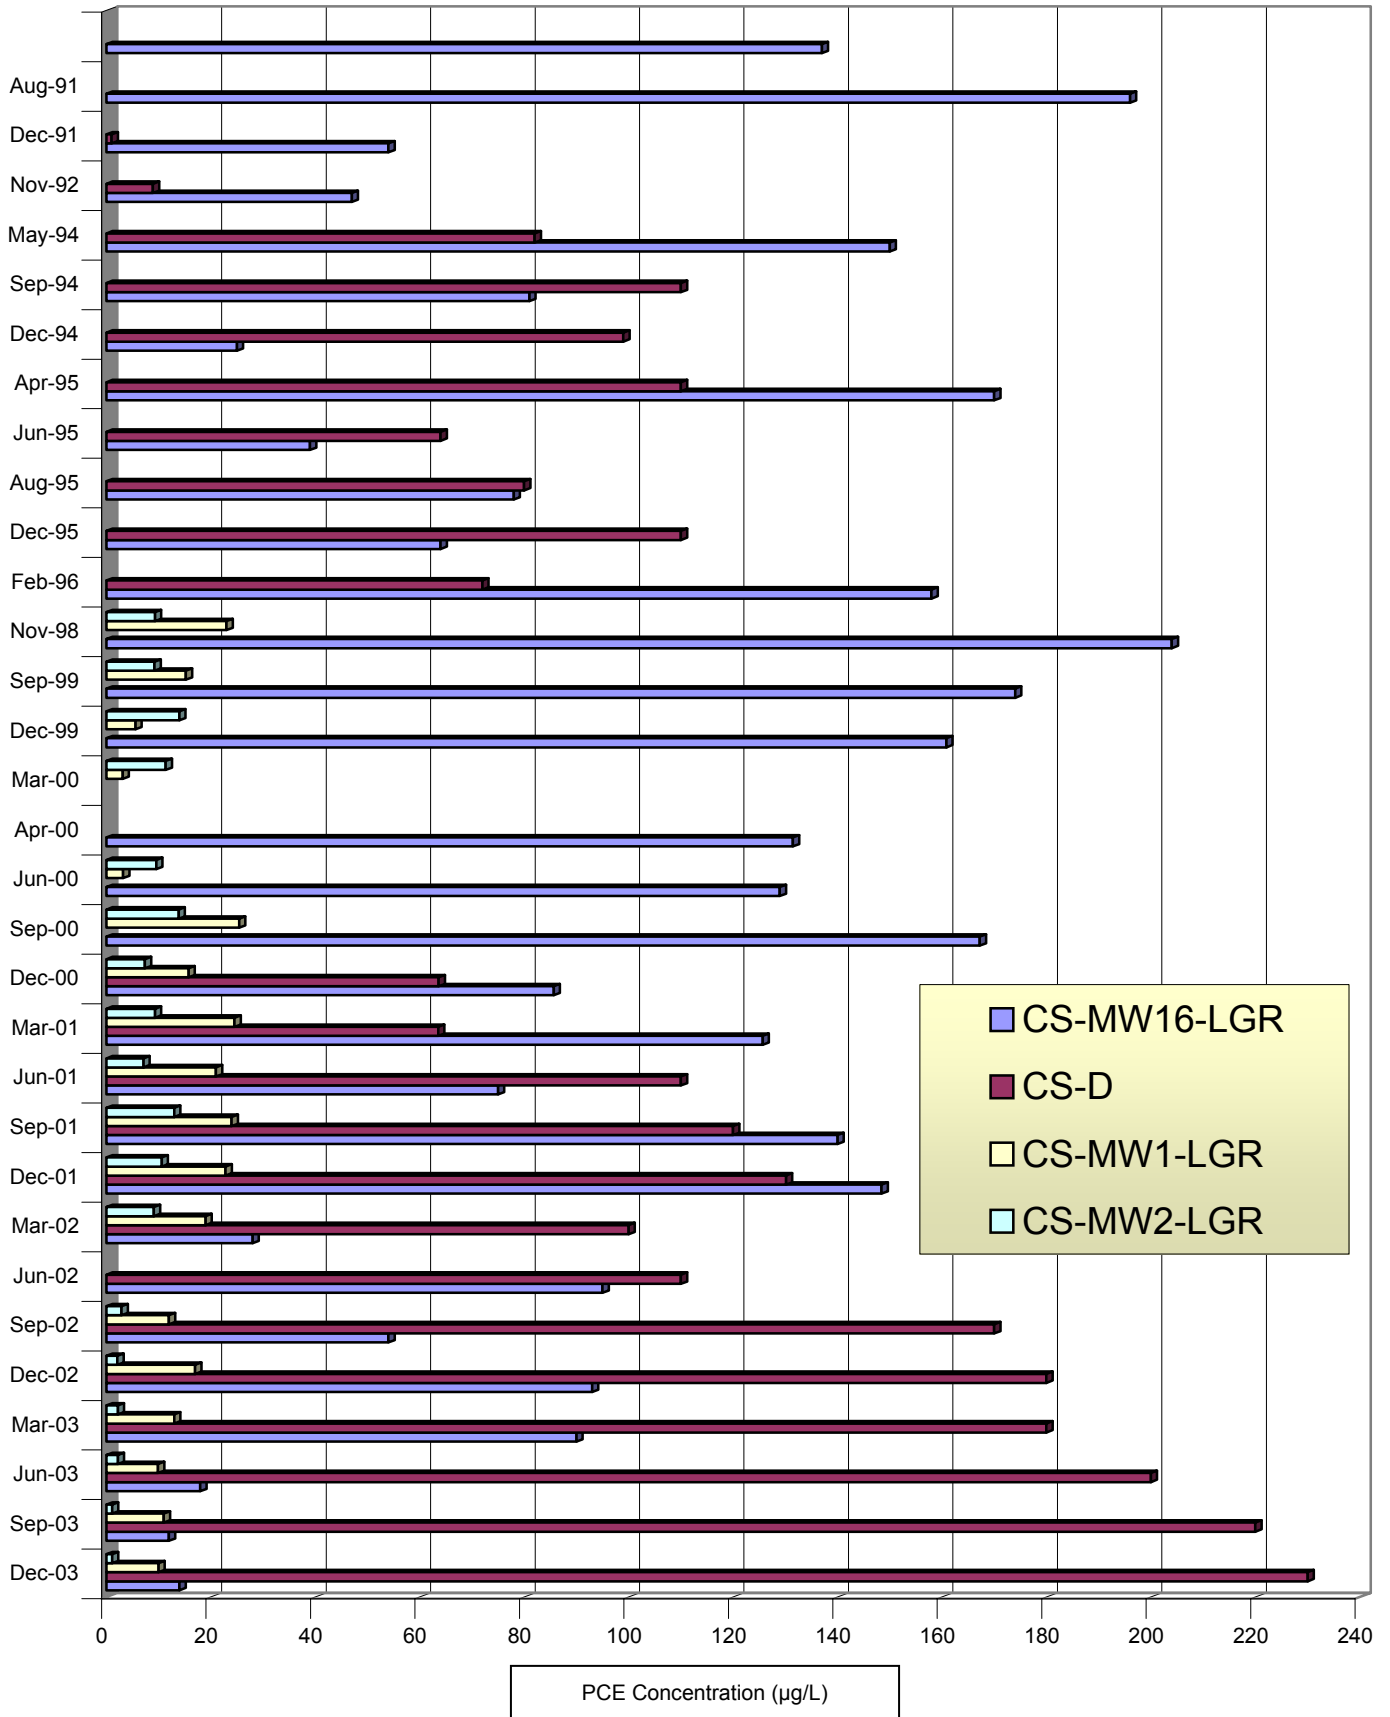

CS-MW1-LGR and CS-MW2-LGR installed May 1996.
 CS-D was dry from September 99 through September 00,
 no samples were collected.