


Figure 5-2,
TCE Concentrations in Wells with Detections above the MCL (5 ug/L)

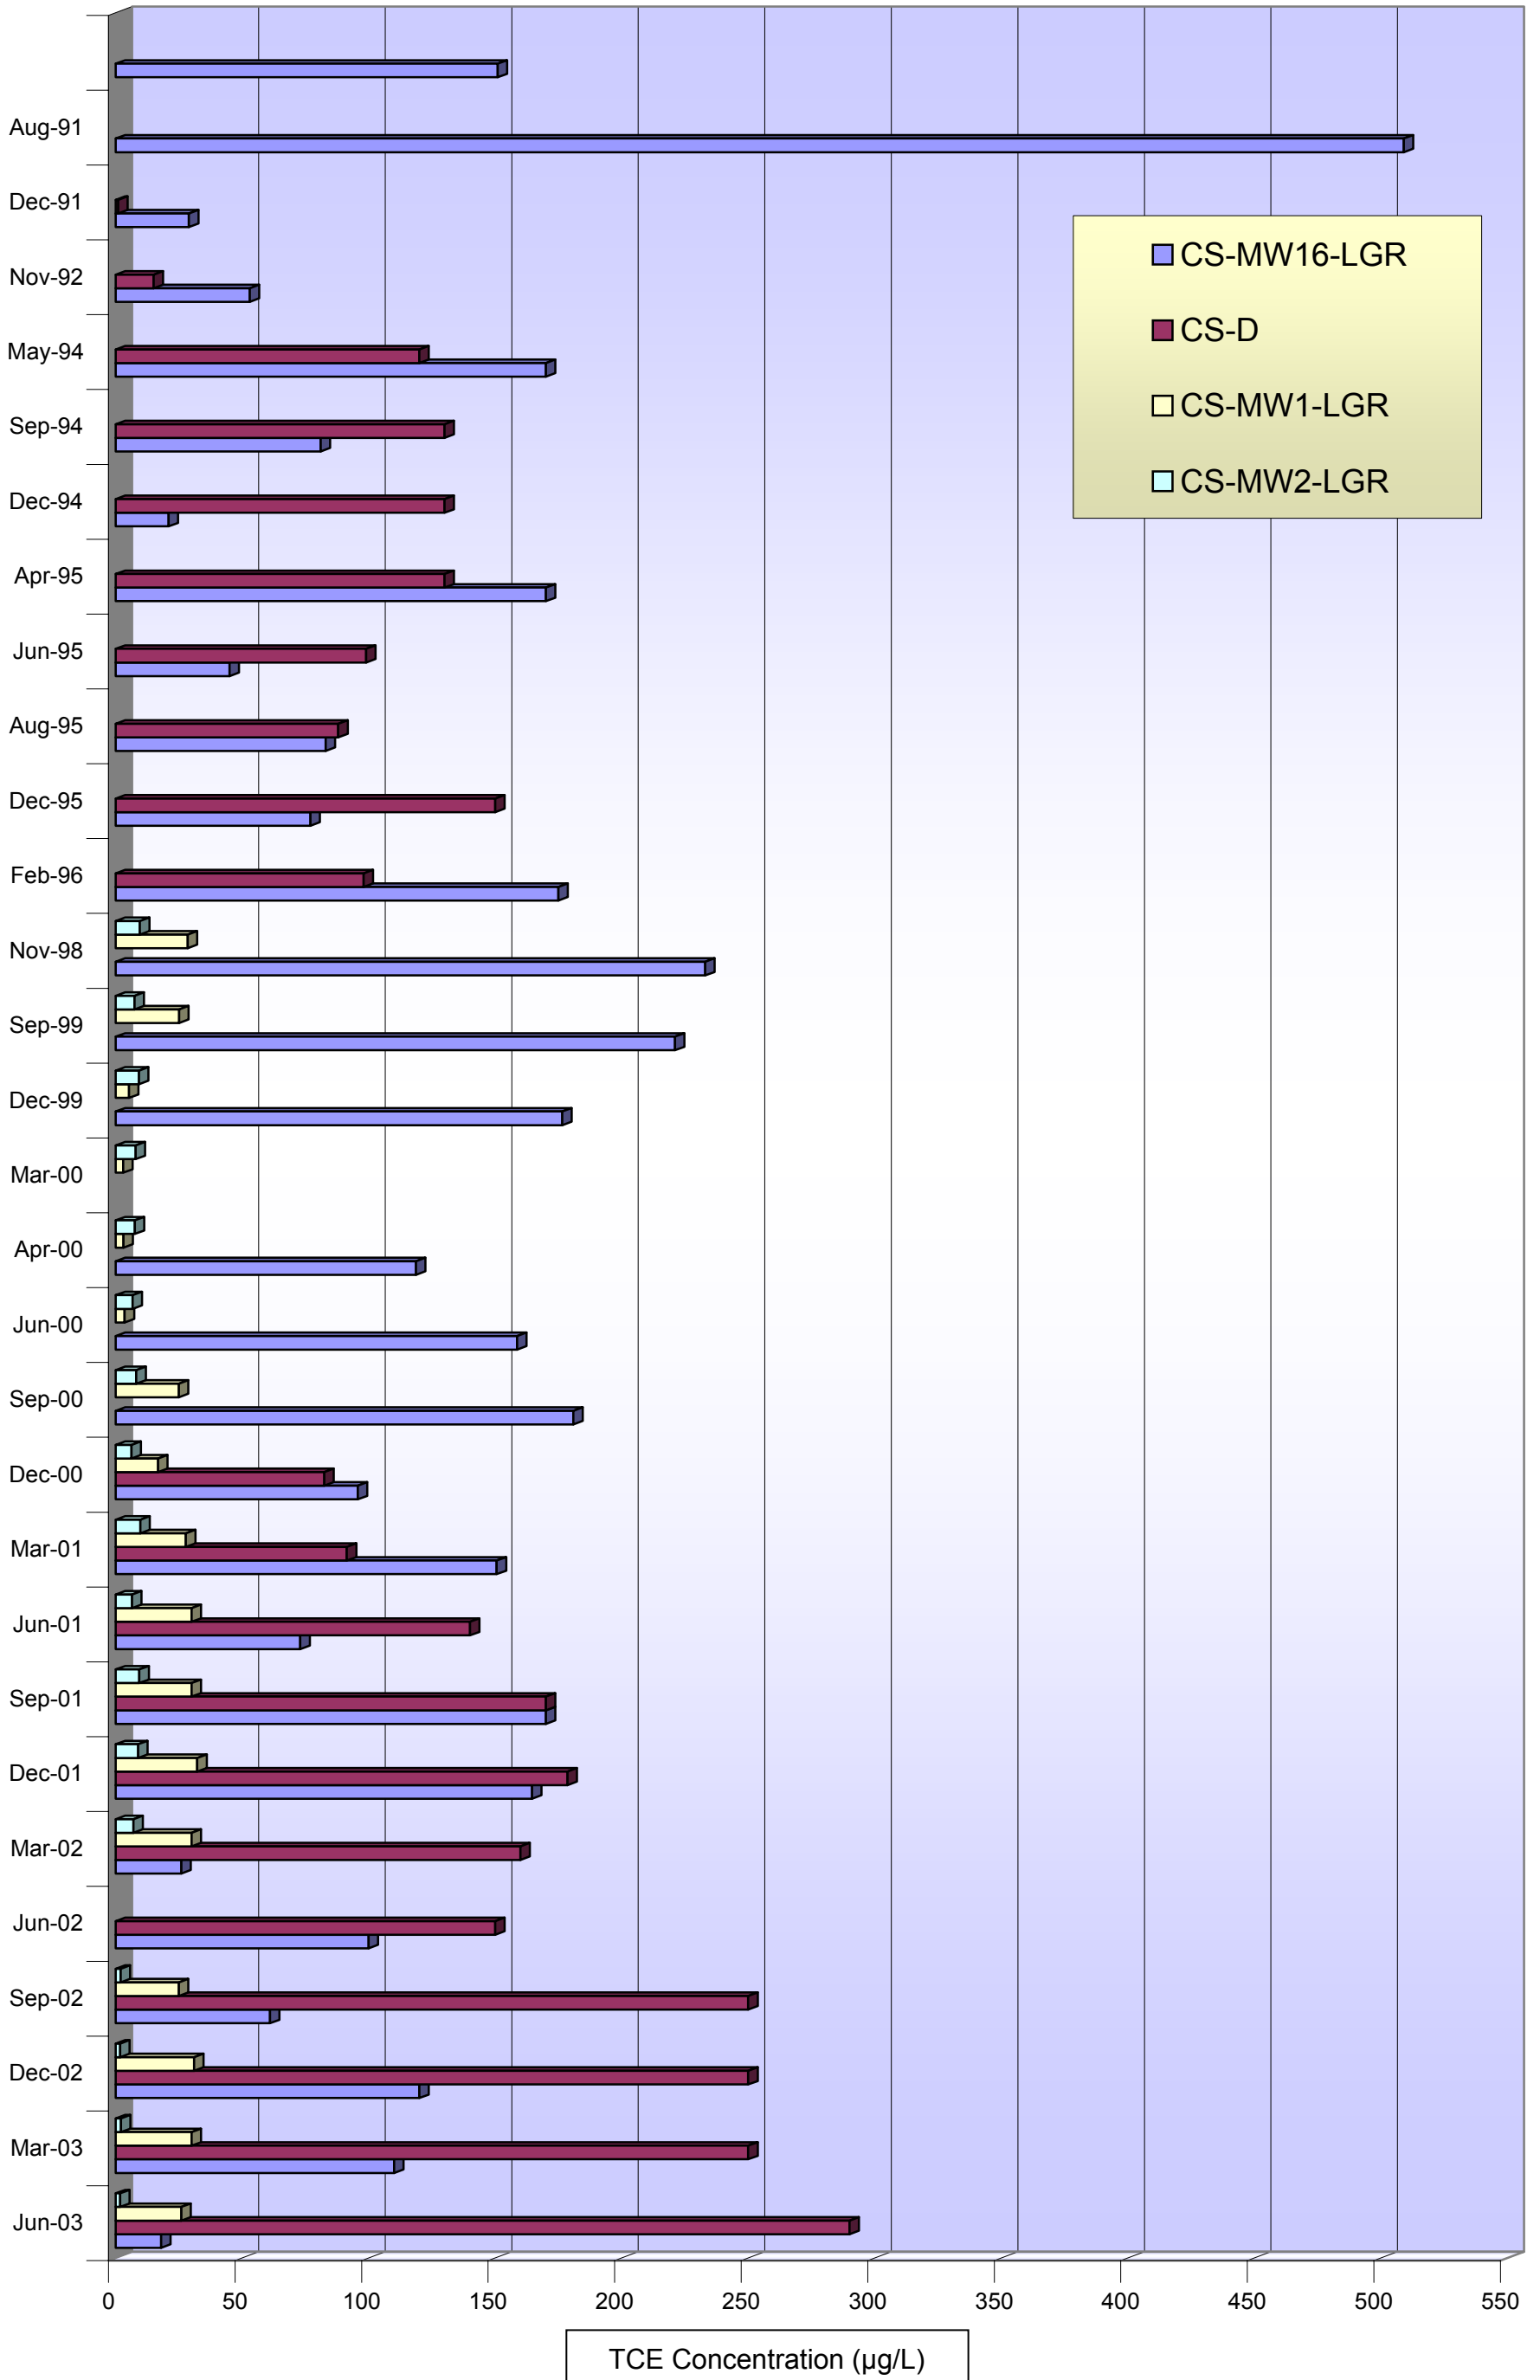

CS-MW1-LGR and CS-MW2-LGR installed May 1996.
CS-D was dry from September 99 through September 00,
no samples were collected.