


Figure 5-1 Concentrations of Selected Analytes since 1998

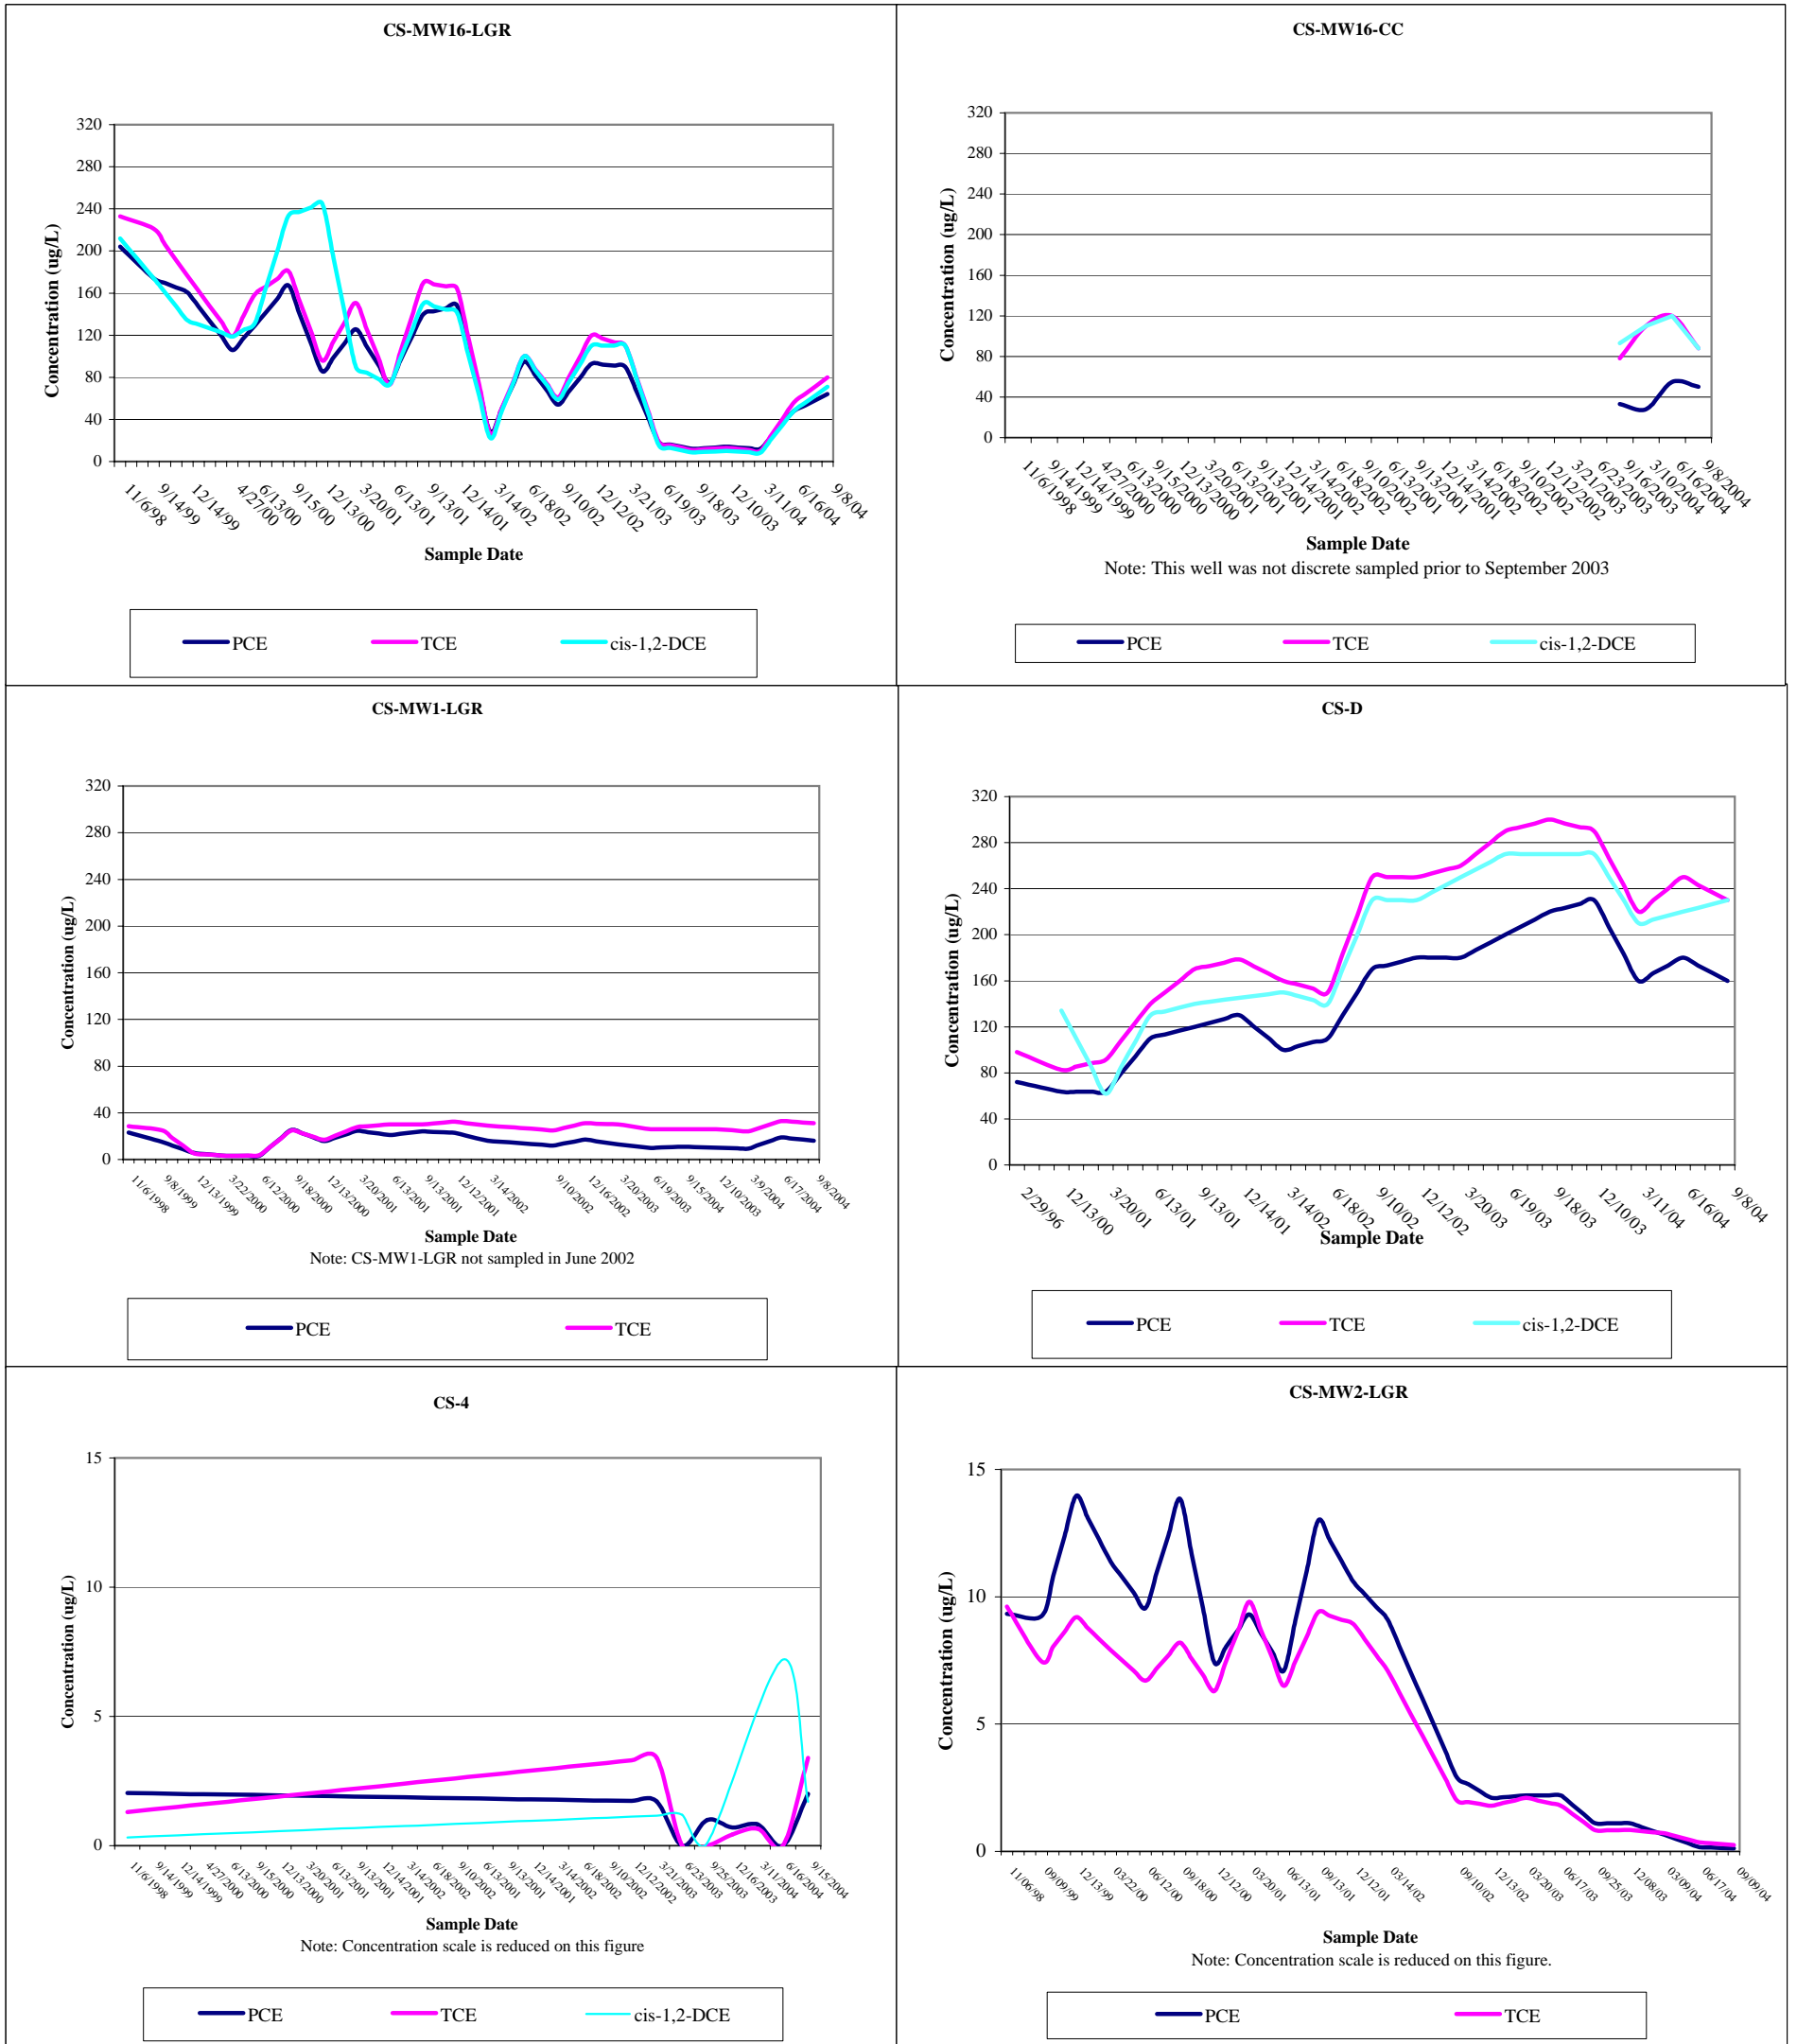

MCL for tetrachlorethene = 5 ug/L  
MCL for trichloroethene = 5 ug/L  
MCL for cis-1,2-dichloroethene = 70 ug/L