

MARCH 2017

On-Post

Quarterly Groundwater Monitoring Report



Prepared For

**Department of the Army
Camp Stanley Storage Activity
Boerne, Texas**

October 2017

EXECUTIVE SUMMARY

- Groundwater samples were collected from 3 of 4 drinking water wells scheduled for monitoring at Camp Stanley Storage Activity (CSSA) in March 2017.
- CSSA experienced above average precipitation volumes during the 1st quarter of 2017; however, the aquifer still experienced a decrease from January to March, 2017. This is likely due to abnormally high groundwater levels measured during the 4th quarter of 2016. The weather station (WS) at Area of Concern (AOC)-65 (AOC-65 WS) did not record a complete set of data due to equipment failure, and the B-3 weather station (B-3 WS) recorded 7.61 inches of rainfall. The average rainfall for this area from January to March is 6.03 inches.
- At CSSA, the Middle Trinity aquifers' average groundwater elevation in March 2017 decreased 8.64 feet from the elevations measured in December 2016. The average depth to water in the wells was 149.53 feet below top of casing (BTOC) or 1092.02 feet above mean sea level (MSL). As such, the Trinity-Glen Rose Groundwater Conservation District (TGRGCD) remains in Stage 1 Moderate Drought conditions since August 13, 2015. For the adjacent Edwards aquifer, the San Antonio Water System (SAWS) also remains in 'year-round watering hours' since December 2, 2015.
- The maximum contaminant level (MCL) for VOCs was not exceeded in drinking water wells sampled in March 2017.
- No wells sampled had metal detections above their corresponding MCL, action level (AL), or secondary standard (SS) in March 2017.
- No zones were scheduled for sampling in March 2017 from Westbay wells CS-WB01 through CS-WB04. However, profile data was collected to determine water levels in each of the zones.
- All samples collected in March 2017 were in accordance with the 2015 long term monitoring optimization (LTMO) report that has been approved by the TCEQ and USEPA.
- One new monitoring well (CS-MW37-LGR) was installed in February to fill a data gap from recently plugged and abandoned (P&A) well LS-1.


GEOSCIENTIST CERTIFICATION

MARCH 2017 ON-POST QUARTERLY GROUNDWATER MONITORING REPORT

FOR

DEPARTMENT OF THE ARMY
CAMP STANLEY STORAGE ACTIVITY
BOERNE, TEXAS

I, Adrien Lindley, Professional Geologist (P.G.), hereby certify that the March 2017 On-Post Quarterly Groundwater Monitoring Report for the Camp Stanley Storage Activity installation in Boerne, Texas accurately represents the site conditions of the subject area. This certification is limited only to geoscientific products contained in the subject report and is made on the basis of written and oral information provided by the CSSA Environmental Office, laboratory data provided by APPL Laboratories, and field data obtained during groundwater monitoring conducted at the site in March 2017, and is true and accurate to the best of my knowledge and belief.

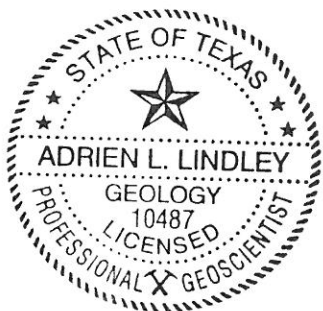

Adrien Lindley, P.G.
State of Texas
Geology License No. 10487

10-17-17

Date

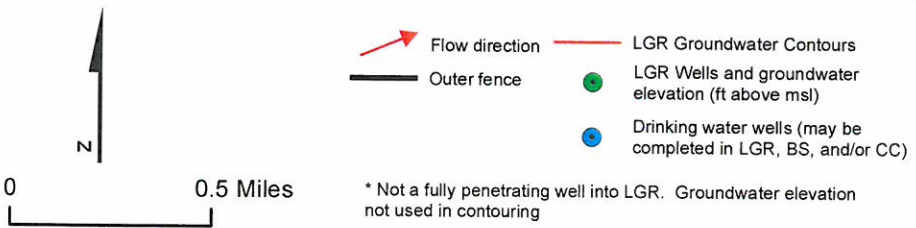
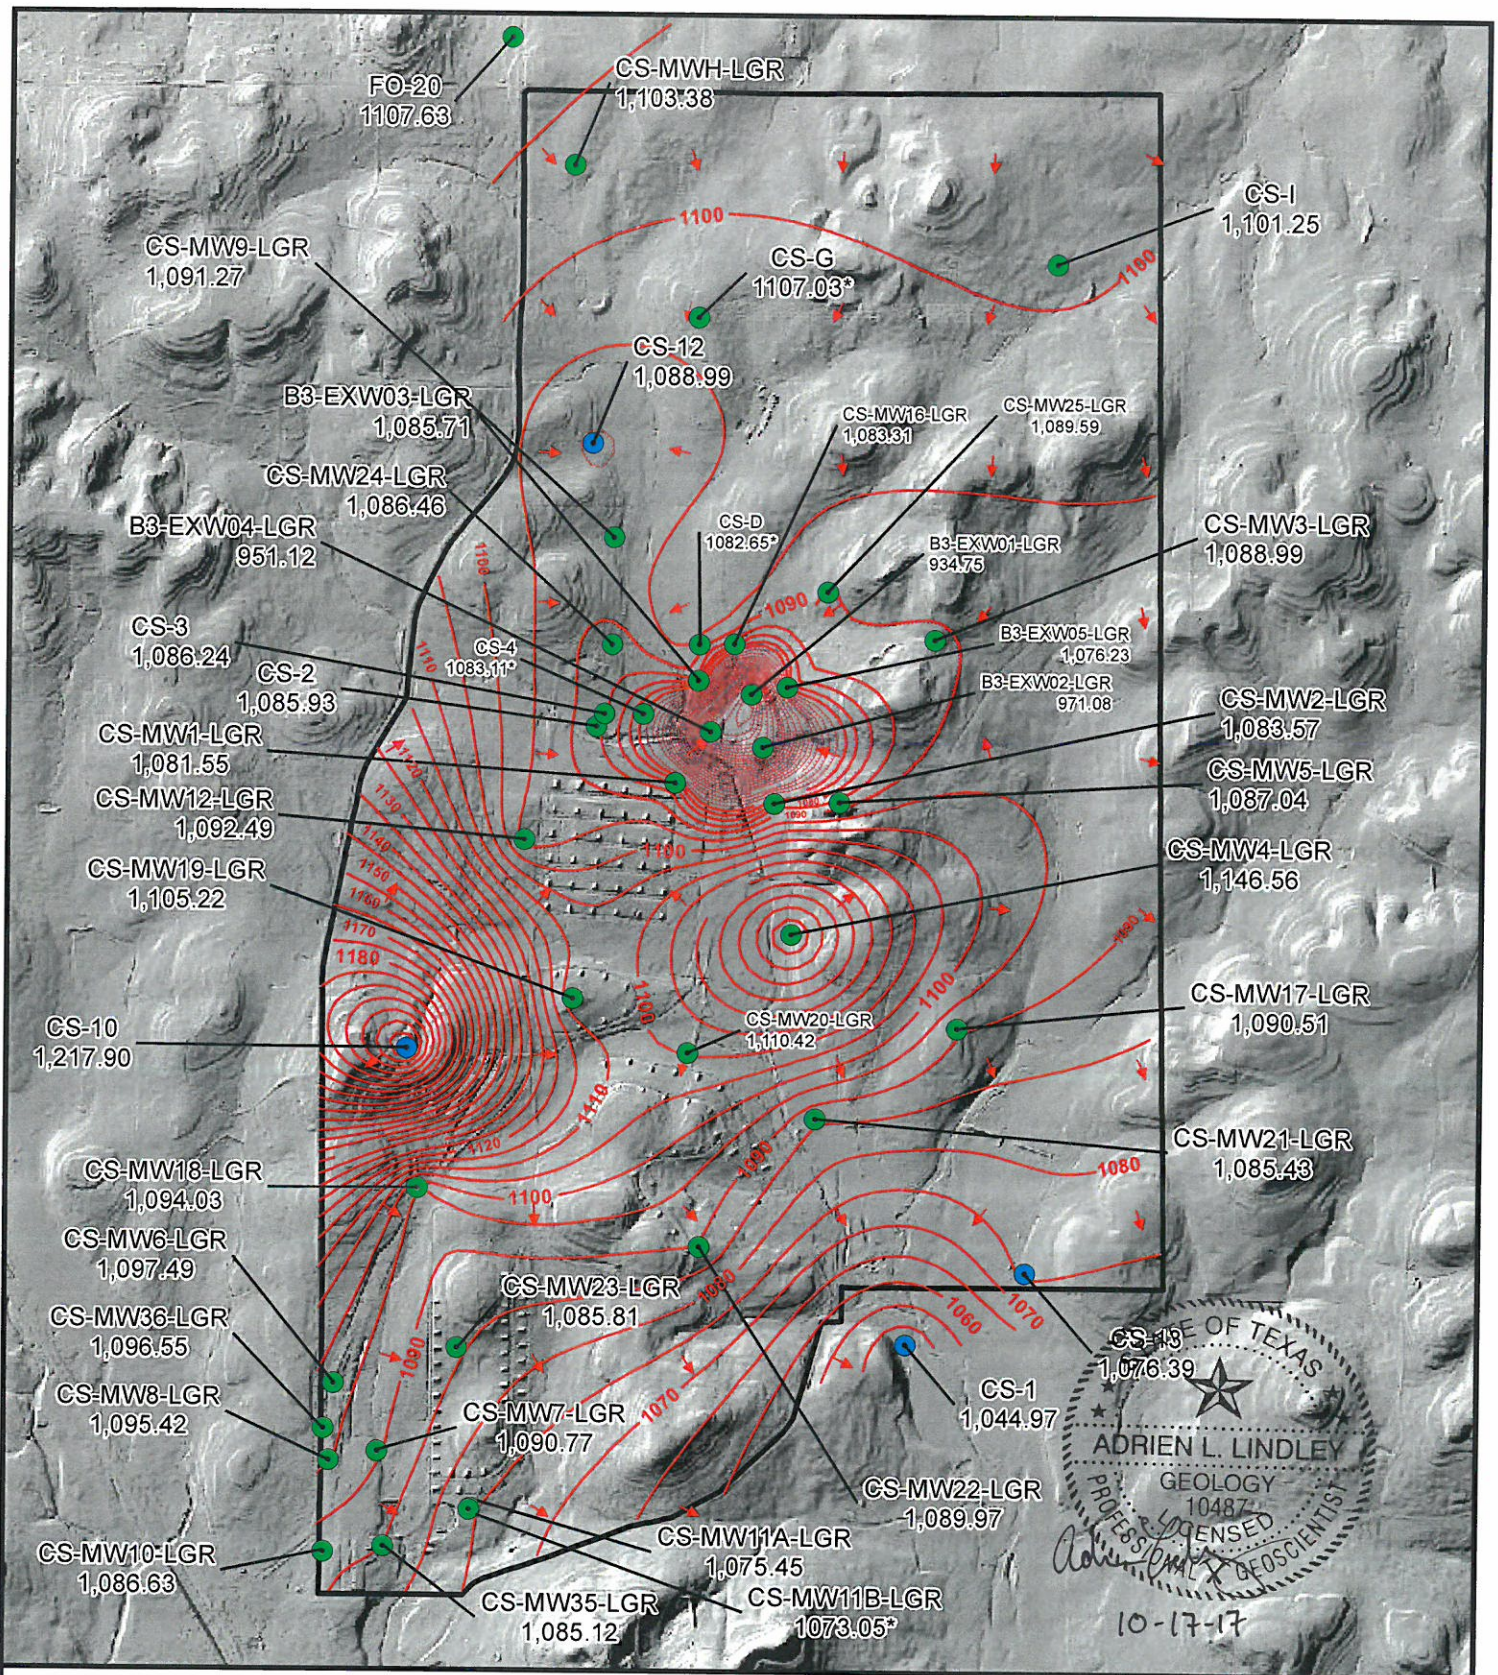


Figure 2.1
 March 2017 Potentiometric Surface Map, LGR Wells
 Camp Stanley Storage Activity
PARSONS



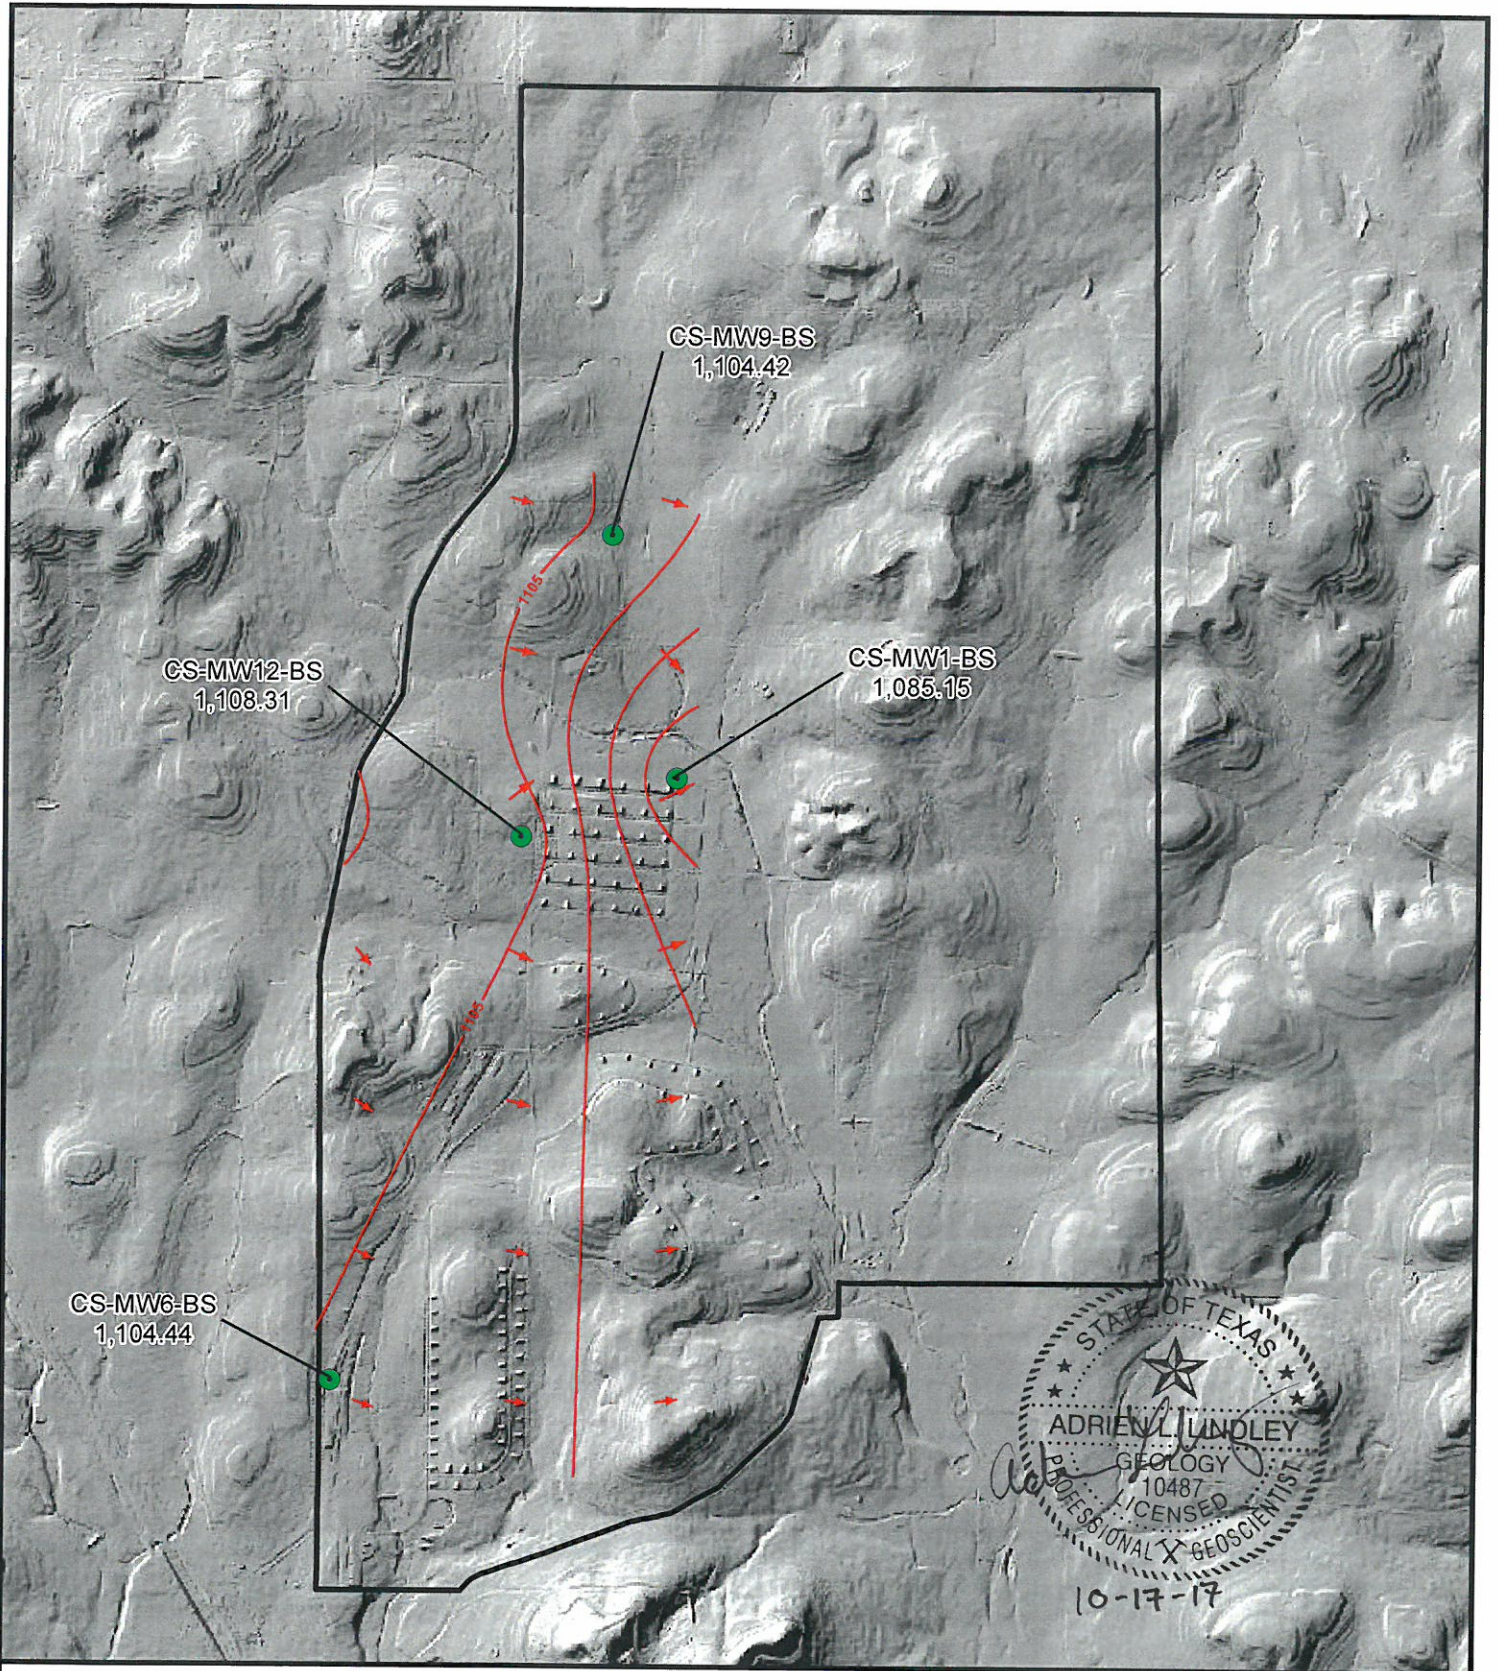


Figure 2-2
 March 2017 Potentiometric Surface Map, BS Wells
 Camp Stanley Storage Activity
PARSONS

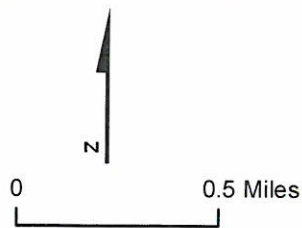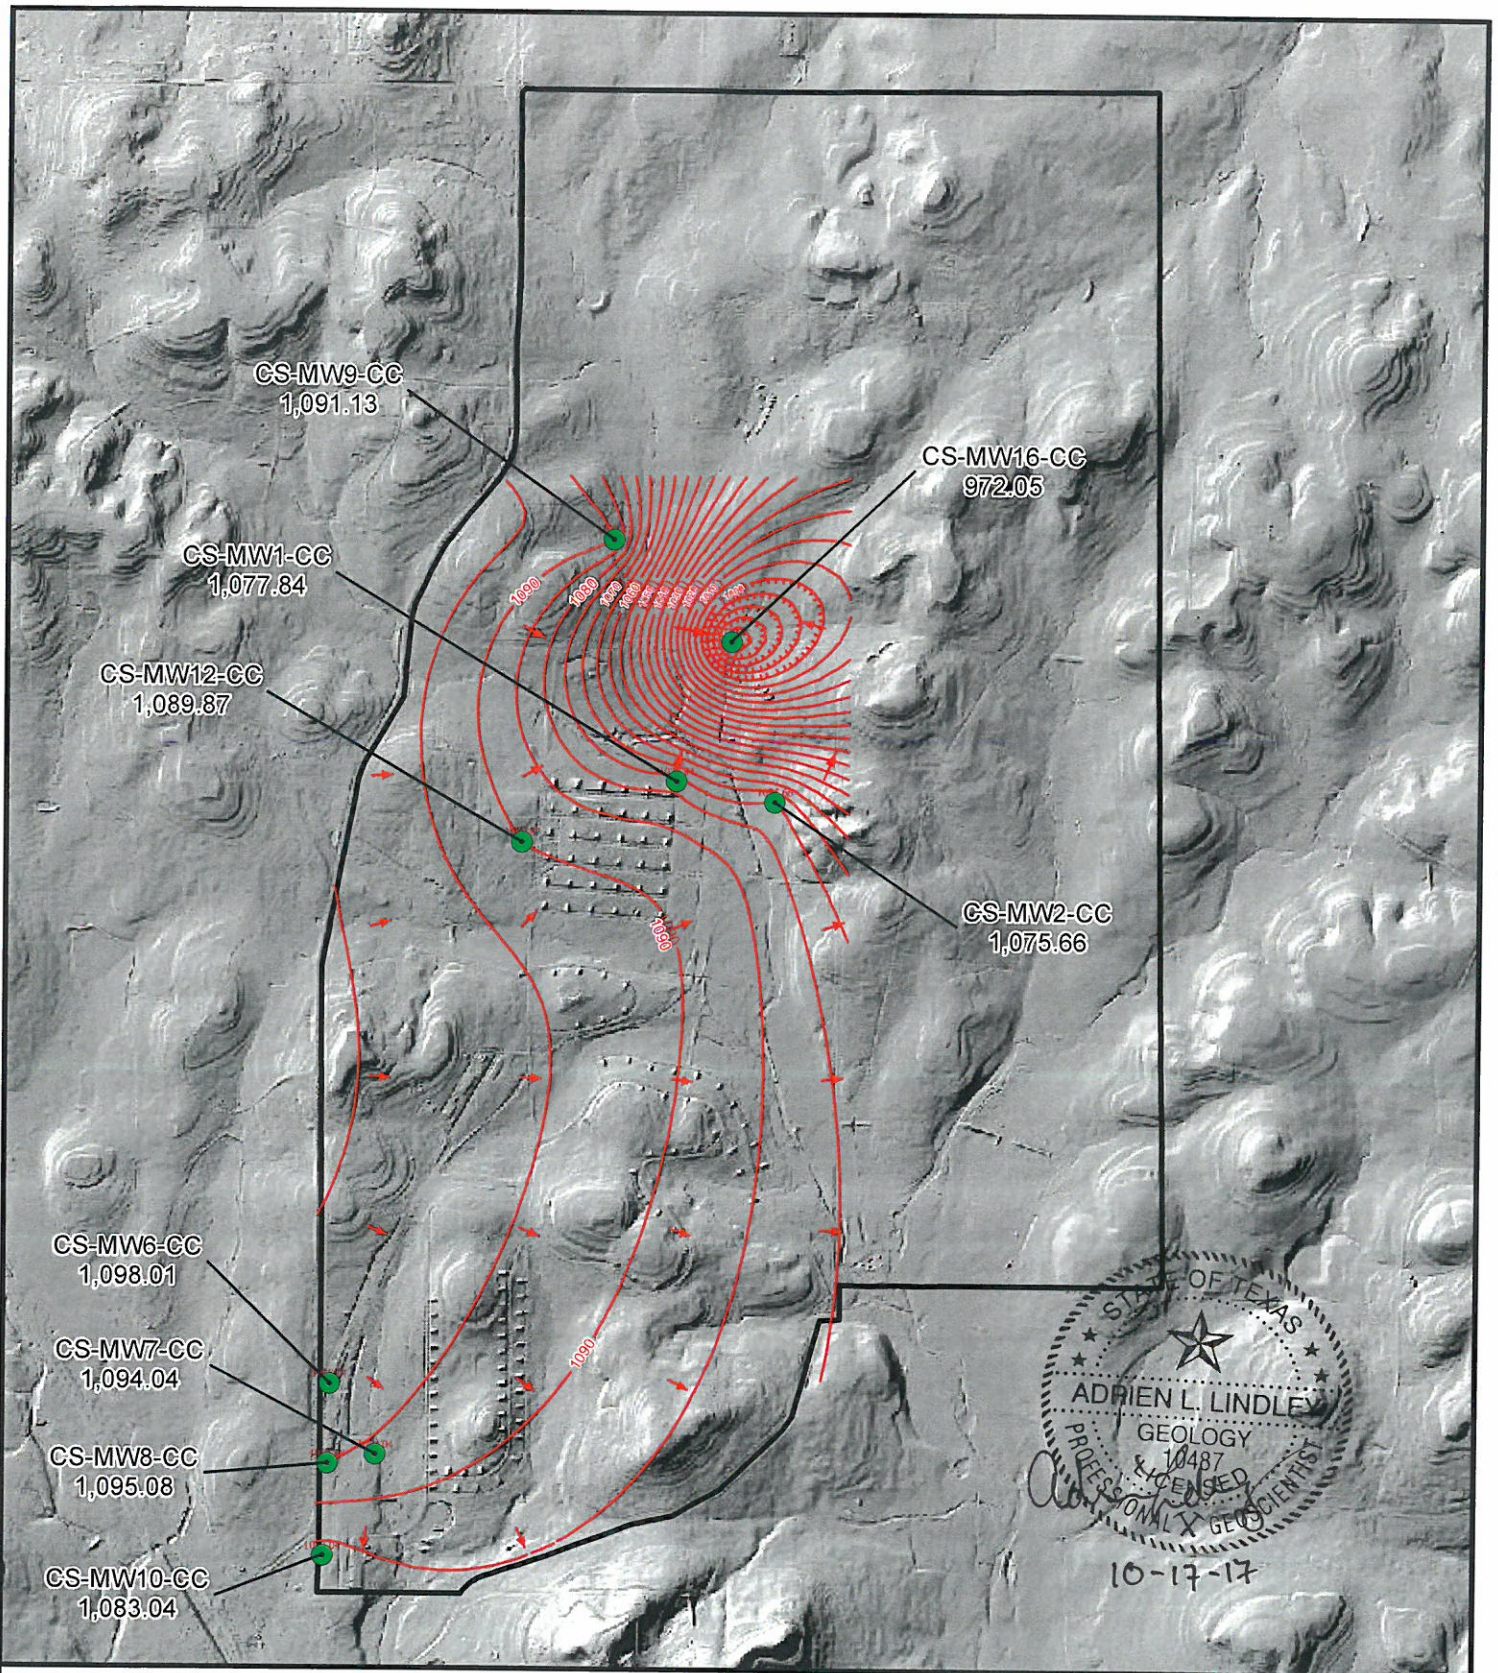

- Flow direction
- Outer fence
- CC Groundwater Contours
- CC Wells and groundwater elevation (ft above msl)

Figure 2-3

March 2017 Potentiometric
Surface Map, CC Wells
Camp Stanley Storage Activity

PARSONS

TABLE OF CONTENTS

| | |
|--|------------|
| EXECUTIVE SUMMARY | ii |
| GEOSCIENTIST CERTIFICATION..... | iii |
| APPENDICES | iv |
| LIST OF TABLES | v |
| LIST OF FIGURES | v |
| ACRONYMS AND ABBREVIATIONS..... | vi |
| 1.0 INTRODUCTION..... | 1-1 |
| 2.0 POST-WIDE FLOW DIRECTION AND GRADIENT | 2-1 |
| 3.0 MARCH ANALYTICAL RESULTS..... | 3-1 |
| 3.1 Monitoring Wells | 3-1 |
| 3.2 Westbay-equipped Wells | 3-7 |
| 3.3 New Monitoring Well Installation | 3-7 |
| 4.0 MARCH 2017 SUMMARY | 4-1 |

APPENDICES

| | |
|------------|---|
| Appendix A | Evaluation of Data Quality Objectives Attainment |
| Appendix B | Quarterly On-Post Groundwater Monitoring Analytical Results, March 2017 |
| Appendix C | Data Validation Report |
| Appendix D | CS-MW37-LGR Analytical Data |

LIST OF TABLES

| | | |
|-----------|---|-----|
| Table 2.1 | Measured Groundwater Elevations – March 2017 | 2-2 |
| Table 2.2 | Changes in Groundwater Elevation from Previous Quarter – March 2017 | 2-3 |
| Table 3.1 | Overview of the On-Post Monitoring Program | 3-2 |
| Table 3.2 | Overview of the On-Post Monitoring Program (Westbay) | 3-3 |
| Table 3.3 | March 2017 On-Post Quarterly Groundwater Results, Detected Analytes | 3-5 |

LIST OF FIGURES

| | | |
|------------|--|-----|
| Figure 2.1 | March 2017 Potentiometric Surface Map, LGR Wells Only | 2-4 |
| Figure 2.2 | March 2017 Potentiometric Surface Map, BS Wells Only | 2-5 |
| Figure 2.3 | March 2017 Potentiometric Surface Map, CC Wells Only | 2-6 |
| Figure 2.4 | Average LGR Groundwater Elevations and Quarterly Precipitation | 2-7 |
| Figure 3.1 | On-Post & Off-Post Well Sampling Locations for March 2017 | 3-4 |
| Figure 3.2 | Cumulative VOC Concentrations vs. Groundwater Elevation | 3-6 |

ACRONYMS AND ABBREVIATIONS

| | |
|-----------------------|--|
| µg/L | microgram per liter |
| 1,1-DCE | 1,1-dichloroethene |
| §3008(h) Order | RCRA 3008(h) Administrative Order on Consent |
| AL | Action Level |
| AOC | Area of Concern |
| APPL | Agriculture and Priority Pollutants Laboratories, Inc. |
| BS | Bexar Shale |
| BTOC | below top of casing |
| CC | Cow Creek |
| <i>cis</i> -1,2-DCE | <i>cis</i> -1,2-Dichloroethene |
| COC | constituents of concern |
| CSSA | Camp Stanley Storage Activity |
| DQO | Data Quality Objectives |
| HSP | Health and Safety Plan |
| ISCO | In-Situ Chemical Oxidation |
| LGR | Lower Glen Rose |
| LTMO | Long-Term Monitoring Optimization |
| MCL | Maximum Contaminant Level |
| MDL | Method Detection Limit |
| MSL | mean sea level |
| NA | Not Available |
| PCE | Tetrachloroethene |
| P.G. | Professional Geologist |
| Parsons | Parsons Government Services, Inc. |
| QAPP | Quality Assurance Project Plan |
| RCRA | Resource Conservation and Recovery Act |
| RL | Reporting Limit |
| SAP | Sampling and Analysis Plan |
| SAWS | San Antonio Water System |
| SS | Secondary Standard |
| SWMU | Solid Waste Management Units |
| TCE | Trichloroethene |
| TCEQ | Texas Commission on Environmental Quality |
| TGRGCD | Trinity-Glen Rose Groundwater Conservation District |
| <i>trans</i> -1,2-DCE | <i>trans</i> -1,2-Dichloroethene |
| UGR | Upper Glen Rose |
| USEPA | United States Environmental Protection Agency |
| VOC | Volatile Organic Compound |
| WS | Weather Station |

MARCH 2017 GROUNDWATER MONITORING REPORT CAMP STANLEY STORAGE ACTIVITY, TEXAS

1.0 INTRODUCTION

This report presents results from the on-post quarterly sampling performed at Camp Stanley Storage Activity (CSSA) in March 2017. Laboratory analytical results are presented along with potentiometric contour maps. Results from all four 2017 quarterly monitoring events (March, June, September, and December) will be described in detail in the 2017 Annual Report. The Annual Report will also provide an interpretation of all analytical results and an evaluation of any temporal or spatial trends observed in the groundwater contaminant plume during investigations. For this specific quarter, groundwater monitoring was performed March 24 through April 4, 2017 by Parsons Government Services, Inc. (Parsons).

Current objectives of the groundwater monitoring program are to determine groundwater flow direction and elevations, determine groundwater contaminant concentrations for characterization purposes, and identify meteorological and seasonal variations in physical and chemical properties. **Appendix A** identifies the data quality objectives (DQOs) for CSSA's groundwater monitoring program, along with an evaluation of whether each DQO was attained. The objectives listed in **Appendix A** also reference appropriate sections of the Resource Conservation and Recovery Act (RCRA) §3008(h) **Administrative Order on Consent** [§3008(h) Order].

The CSSA groundwater monitoring program follows the provisions of the groundwater monitoring program DQOs as well as the recommendations of the **Three-Tiered Long Term Monitoring Network Optimization (LTMO) Evaluation (Parsons, 2015)** which provided recommendations for sampling based on an LTMO study performed for the CSSA groundwater monitoring program. The LTMO evaluation was updated in 2015 using groundwater data from monitoring conducted between 2010 and 2015. The proposed LTMO changes/updates were approved by the TCEQ and USEPA April 22 and May 5, 2016, respectively. These changes were briefed to the public in the 2016 Annual Fact Sheet. The updated LTMO study sampling frequencies were implemented in December 2016.

2.0 POST-WIDE FLOW DIRECTION AND GRADIENT

After above average rainfall in 2016 and continued steady rain events in early 2017, the San Antonio Water System (SAWS) restrictions remain under ‘year-round watering hours’ since December 2, 2015. The Trinity-Glen Rose Groundwater Conservation District (TGRGCD) remains in Stage 1 water restrictions since August 13, 2015.

The 30-year precipitation normal for the San Antonio area is 6.03 inches of rainfall for the three-month period of January through March. Over the 3-month period of record, the weather station (WS) at B-3 (B-3 WS), recorded 7.61 inches of rainfall (2.52 inches in January, 3.49 inches in February, and 1.60 inches in March). One day in January and 2 days in February had daily rainfall totals in excess of 1 inch at B-3. The Area of Concern (AOC-65) weather station (AOC-65 WS) did not record a complete set of data in this timeframe due to battery failure. The battery was replaced and the AOC-65 WS was back online February 16, 2017.

Fifty-six water level measurements were recorded on March 24, 2017 from on- and off-post monitoring wells completed in the Lower Glen Rose (LGR), Bexar Shale (BS), and Cow Creek (CC) formational members of the Middle Trinity Aquifer (**Tables 2.1 and 2.2**). The groundwater potentiometric surface maps illustrating groundwater elevations from the LGR, BS, and CC zones in March 2017 are shown in **Figures 2.1, 2.2, and 2.3**, respectively.

The March 2017 potentiometric surface map for LGR-screened wells (**Figure 2.1**) exhibited a wide range of groundwater elevations, from a minimum of 934.75 feet above mean sea level (MSL) at B3-EXW01 to a maximum of 1,146.56 feet above MSL at CS-MW4-LGR. Groundwater elevations are generally higher in the northern and central portions of CSSA, and decrease to the southwest and southeast. As measured in all non-pumping wells, the average groundwater elevation in March 2017 decreased 13.21 feet from the elevations measured in December 2016, but is still well above the average groundwater level for the area. The groundwater elevation is approximately 60 feet above the 14.25 year average elevation measured in CSSA monitoring wells (**Figure 2.4**).


Well CS-MW4-LGR, located in the central portion of CSSA, typically has one of the highest groundwater elevations of LGR-screened wells. Under average and above-average aquifer elevations, the groundwater level is 20 to 30 feet higher than the nearest comparable wells (CS-MW2-LGR and CS-MW5-LGR), creating a pronounced groundwater mound in the central portion of the facility. In March 2017, this mounding effect was observable as the elevation in CS-MW4-LGR was approximately 65 feet higher than CS-MW2-LGR and 60 feet higher than CS-MW5-LGR. Long-term monitoring has ascertained that when groundwater in the vicinity of CS-MW4-LGR rises above about 970 feet MSL, the mounding effect is evident. As measured in March 2017, the water elevation at CS-MW4-LGR was 1,146.56 feet MSL, and the typical mounding effect was evident.

Table 2.1
Measured Groundwater Elevation
March 2017

| Well ID: | TOC elevation (ft MSL) | Depth to Groundwater (ft BTOC) | Groundwater Elevation (ft MSL) | Formations Screened | | | Date |
|--|---------------------------|-----------------------------------|-----------------------------------|---------------------|----------------|----------------|-----------|
| | | | | LGR | BS | CC | |
| CS-1 | 1169.27 | 124.30 | 1044.97 | ALL | | | 3/24/2017 |
| CS-2 | 1237.59 | 151.66 | 1085.93 | X | ? | | 3/24/2017 |
| CS-3 | 1240.17 | 153.93 | 1086.24 | X | | | 3/24/2017 |
| CS-4 | 1229.28 | 146.17 | 1083.11 | X | | | 3/24/2017 |
| CS-10* | 1331.51 | 113.61 | 1217.90 | ALL | | | 3/24/2017 |
| CS-12 | 1274.09 | 185.10 | 1088.99 | ALL | | | 3/24/2017 |
| CS-13 | 1193.26 | 116.87 | 1076.39 | ALL | | | 3/24/2017 |
| CS-D | 1236.03 | 153.38 | 1082.65 | X | | | 3/24/2017 |
| CS-MWG-LGR | 1328.14 | 221.11 | 1107.03 | X | | | 3/24/2017 |
| CS-MWH-LGR | 1319.19 | 215.82 | 1103.37 | X | | | 3/24/2017 |
| CS-I | 1315.20 | 213.95 | 1101.25 | X | | | 3/24/2017 |
| CS-MW1-LGR | 1220.73 | 139.18 | 1081.55 | X | | | 3/24/2017 |
| CS-MW1-BS | 1221.09 | 135.94 | 1085.15 | | X | | 3/24/2017 |
| CS-MW1-CC | 1221.39 | 143.55 | 1077.84 | | | X | 3/24/2017 |
| CS-MW2-LGR | 1237.08 | 153.51 | 1083.57 | X | | | 3/24/2017 |
| CS-MW2-CC | 1240.11 | 164.45 | 1075.66 | | | X | 3/24/2017 |
| CS-MW3-LGR | 1334.14 | 245.15 | 1088.99 | X | | | 3/24/2017 |
| CS-MW4-LGR | 1209.71 | 63.15 | 1146.56 | X | | | 3/24/2017 |
| CS-MW5-LGR | 1340.24 | 253.20 | 1087.04 | X | | | 3/24/2017 |
| CS-MW6-LGR | 1232.25 | 134.76 | 1097.49 | X | | | 3/24/2017 |
| CS-MW6-BS | 1232.67 | 128.23 | 1104.44 | | X | | 3/24/2017 |
| CS-MW6-CC | 1233.21 | 135.20 | 1098.01 | | | X | 3/24/2017 |
| CS-MW7-LGR | 1202.27 | 111.50 | 1090.77 | X | | | 3/24/2017 |
| CS-MW7-CC | 1201.84 | 107.80 | 1094.04 | | | X | 3/24/2017 |
| CS-MW8-LGR | 1208.35 | 112.93 | 1095.42 | X | | | 3/24/2017 |
| CS-MW8-CC | 1206.13 | 111.05 | 1095.08 | | | X | 3/24/2017 |
| CS-MW9-LGR | 1257.27 | 166.00 | 1091.27 | X | | | 3/24/2017 |
| CS-MW9-BS | 1256.73 | 152.31 | 1104.42 | | X | | 3/24/2017 |
| CS-MW9-CC | 1255.95 | 164.82 | 1091.13 | | | X | 3/24/2017 |
| CS-MW10-LGR | 1189.53 | 102.90 | 1086.63 | X | | | 3/24/2017 |
| CS-MW10-CC | 1190.04 | 107.00 | 1083.04 | | | X | 3/24/2017 |
| CS-MW11A-LGR | 1204.03 | 128.58 | 1075.45 | X | | | 3/24/2017 |
| CS-MW11B-LGR | 1203.52 | 130.47 | 1073.05 | X | | | 3/24/2017 |
| CS-MW12-LGR | 1259.07 | 166.58 | 1092.49 | X | | | 3/24/2017 |
| CS-MW12-BS | 1258.37 | 150.06 | 1108.31 | | X | | 3/24/2017 |
| CS-MW12-CC | 1257.31 | 167.44 | 1089.87 | | | X | 3/24/2017 |
| CS-MW16-LGR | 1244.60 | 161.29 | 1083.31 | X | | | 3/24/2017 |
| CS-MW16-CC* | 1244.51 | 272.46 | 972.05 | | | X | 3/24/2017 |
| B3-EXW01* | 1245.26 | 310.51 | 934.75 | X | | | 3/24/2017 |
| B3-EXW02* | 1249.66 | 278.58 | 971.08 | X | | | 3/24/2017 |
| B3-EXW03 | 1235.11 | 149.40 | 1085.71 | X | | | 3/24/2017 |
| B3-EXW04* | 1228.46 | 277.34 | 951.12 | X | | | 3/24/2017 |
| B3-EXW05 | 1279.46 | 203.23 | 1076.23 | X | | | 3/24/2017 |
| CS-MW17-LGR | 1257.01 | 166.50 | 1090.51 | X | | | 3/24/2017 |
| CS-MW18-LGR | 1283.61 | 189.58 | 1094.03 | X | | | 3/24/2017 |
| CS-MW19-LGR | 1255.53 | 150.31 | 1105.22 | X | | | 3/24/2017 |
| CS-MW20-LGR | 1209.42 | 99.00 | 1110.42 | X | | | 3/24/2017 |
| CS-MW21-LGR | 1184.53 | 99.10 | 1085.43 | X | | | 3/24/2017 |
| CS-MW22-LGR | 1280.49 | 190.52 | 1089.97 | X | | | 3/24/2017 |
| CS-MW23-LGR | 1258.20 | 172.39 | 1085.81 | X | | | 3/24/2017 |
| CS-MW24-LGR | 1253.90 | 167.44 | 1086.46 | X | | | 3/24/2017 |
| CS-MW25-LGR | 1293.01 | 203.42 | 1089.59 | X | | | 3/24/2017 |
| CS-MW35-LGR | 1186.97 | 101.85 | 1085.12 | X | | | 3/24/2017 |
| CS-MW36-LGR | 1218.74 | 122.19 | 1096.55 | X | | | 3/24/2017 |
| CS-MW37-LGR | NA | 115.91 | NA | X | | | 3/24/2017 |
| FO-20 | 1327.00 | 219.37 | 1107.63 | | ALL | | 3/24/2017 |
| Number of wells screened in each formation. | | | | 37 | 4 | 9 | |
| Average groundwater elevation in each formation given in feet (non pumping wells). | | | | 1092.13 | 1100.58 | 1088.08 | |
| Notes: | | | | | | | |
| Bold wells: CS-2, CS-10, CS-12, CS-13, and FO-20 are open boreholes across more than one formational unit. | | | | | | | |
| ? = Exact screening information unknown for this well. | | | | | | | |
| Shaded wells are routinely pumped for either domestic, livestock, or environmental remediation purposes, and therefore are not used in calculating statistics. | | | | | | | |
| CS-1, CS-10, CS-12, and CS-13 are current or future drinking water wells. | | | | | | | |
| CS-MW16-LGR, CS-MW16-CC, B3-EXW01 through B3-EXW05 pumps are cycling continuously to feed the B-3 Bioreactor. | | | | | | | |
| * = submersible pump running at time of water level measurement. | | | | | | | |
| Formational average groundwater elevation is calculated from non-pumping wells screened in only one formation. | | | | | | | |
| All measurements given in feet. | | | | | | | |
| NA = Data not available | | | | | | | |

Table 2.2
Change in Groundwater Elevation from Previous Quarter
March 2017

| Well ID | Dec. 2016 Elevations | Mar. 2017 Elevations | GW elevation change (Mar. minus Dec.) | Formations Screened | | |
|--|----------------------|----------------------|--|---------------------|--------------|--------------|
| | | | | LGR | BS | CC |
| CS-1* | 1001.67 | 1044.97 | 43.30 | ALL | | |
| CS-2 | 1103.66 | 1085.93 | -17.73 | X | ? | |
| CS-3 | 1104.17 | 1086.24 | -17.93 | X | | |
| CS-4 | 1102.85 | 1083.11 | -19.74 | X | | |
| CS-10* | 1108.94 | 1217.90 | 108.96 | ALL | | |
| CS-12 | 1093.49 | 1088.99 | -4.50 | ALL | | |
| CS-13 | 1074.85 | 1076.39 | 1.54 | ALL | | |
| CS-D | 1097.46 | 1082.65 | -14.81 | X | | |
| CS-MWG-LGR | 1110.73 | 1107.03 | -3.70 | X | | |
| CS-MWH-LGR | 1112.85 | 1103.37 | -9.48 | X | | |
| CS-I | 1103.65 | 1101.25 | -2.40 | X | | |
| CS-MW1-LGR | 1103.51 | 1081.55 | -21.96 | X | | |
| CS-MW1-BS | 1063.82 | 1085.15 | 21.33 | | X | |
| CS-MW1-CC | 1085.05 | 1077.84 | -7.21 | | | X |
| CS-MW2-LGR | 1099.06 | 1083.57 | -15.49 | X | | |
| CS-MW2-CC | 1067.35 | 1075.66 | 8.31 | | | X |
| CS-MW3-LGR | 1096.12 | 1088.99 | -7.13 | X | | |
| CS-MW4-LGR | 1158.43 | 1146.56 | -11.87 | X | | |
| CS-MW5-LGR | 1095.60 | 1087.04 | -8.56 | X | | |
| CS-MW6-LGR | 1110.94 | 1097.49 | -13.45 | X | | |
| CS-MW6-BS | 1085.55 | 1104.44 | 18.89 | | X | |
| CS-MW6-CC | 1095.01 | 1098.01 | 3.00 | | | X |
| CS-MW7-LGR | 1104.62 | 1090.77 | -13.85 | X | | |
| CS-MW7-CC | 1096.45 | 1094.04 | -2.41 | | | X |
| CS-MW8-LGR | 1109.05 | 1095.42 | -13.63 | X | | |
| CS-MW8-CC | 1096.29 | 1095.08 | -1.21 | | | X |
| CS-MW9-LGR | 1106.13 | 1091.27 | -14.86 | X | | |
| CS-MW9-BS | 1097.68 | 1104.42 | 6.74 | | X | |
| CS-MW9-CC | 1095.65 | 1091.13 | -4.52 | | | X |
| CS-MW10-LGR | 1102.22 | 1086.63 | -15.59 | X | | |
| CS-MW10-CC | 1098.88 | 1083.04 | -15.84 | | | X |
| CS-MW11A-LGR | 1089.03 | 1075.45 | -13.58 | X | | |
| CS-MW11B-LGR | 1094.94 | 1073.05 | -21.89 | X | | |
| CS-MW12-LGR | 1108.94 | 1092.49 | -16.45 | X | | |
| CS-MW12-BS | 1076.92 | 1108.31 | 31.39 | | X | |
| CS-MW12-CC | 1095.78 | 1089.87 | -5.91 | | | X |
| CS-MW16-LGR | 1094.04 | 1083.31 | -10.73 | X | | |
| CS-MW16-CC* | 1083.06 | 972.05 | -111.01 | | | X |
| B3-EXW01* | 942.79 | 934.75 | -8.04 | X | | |
| B3-EXW02* | 1092.43 | 971.08 | -121.35 | X | | |
| B3-EXW03 | 1103.31 | 1085.71 | -17.60 | X | | |
| B3-EXW04* | 1096.96 | 951.12 | -145.84 | X | | |
| B3-EXW05 | 1087.53 | 1076.23 | -11.30 | X | | |
| CS-MW17-LGR | 1099.97 | 1090.51 | -9.46 | X | | |
| CS-MW18-LGR | 1109.48 | 1094.03 | -15.45 | X | | |
| CS-MW19-LGR | 1118.98 | 1105.22 | -13.76 | X | | |
| CS-MW20-LGR | 1122.86 | 1110.42 | -12.44 | X | | |
| CS-MW21-LGR | 1100.03 | 1085.43 | -14.60 | X | | |
| CS-MW22-LGR | 1100.93 | 1089.97 | -10.96 | X | | |
| CS-MW23-LGR | 1099.68 | 1085.81 | -13.87 | X | | |
| CS-MW24-LGR | 1103.03 | 1086.46 | -16.57 | X | | |
| CS-MW25-LGR | 1099.58 | 1089.59 | -9.99 | X | | |
| CS-MW35-LGR | 1098.25 | 1085.12 | -13.13 | X | | |
| CS-MW36-LGR | 1109.85 | 1096.55 | -13.30 | X | | |
| CS-MW37-LGR | NA | NA | NA | X | | |
| FO-20 | 1114.35 | 1107.63 | -6.72 | ALL | | |
| Average groundwater elevation change (all wells minus pumping wells) | | | -8.64 | | | |
| Average groundwater elevation change in each formation (non pumping wells) | | | | -13.56 | 19.59 | -3.22 |
| Notes: | | | | | | |
| Bold wells: CS-2, CS-10, CS-12, CS-13, and FO-20 are open boreholes across more than one formational unit. | | | | | | |
| ? = Exact screening information unknown for this well. | | | | | | |
| Shaded wells are routinely pumped for either domestic, livestock, or environmental remediation purposes, and therefore are not used in calculating statistics. | | | | | | |
| CS-1, CS-9, CS-10, CS-12, and CS-13 are current, inactive, or future drinking water wells. | | | | | | |
| CS-MW16-LGR, CS-MW16-CC, B3-EXW01 through B3-EXW05 pumps are cycling continuously to feed the B-3 Bioreactor. | | | | | | |
| * = submersible pump running at time of water level measurement. | | | | | | |
| Formational average groundwater elevation change is calculated from non-pumping wells screened in only one formation. | | | | | | |
| All measurements given in feet. | | | | | | |
| NA = Data not available | | | | | | |

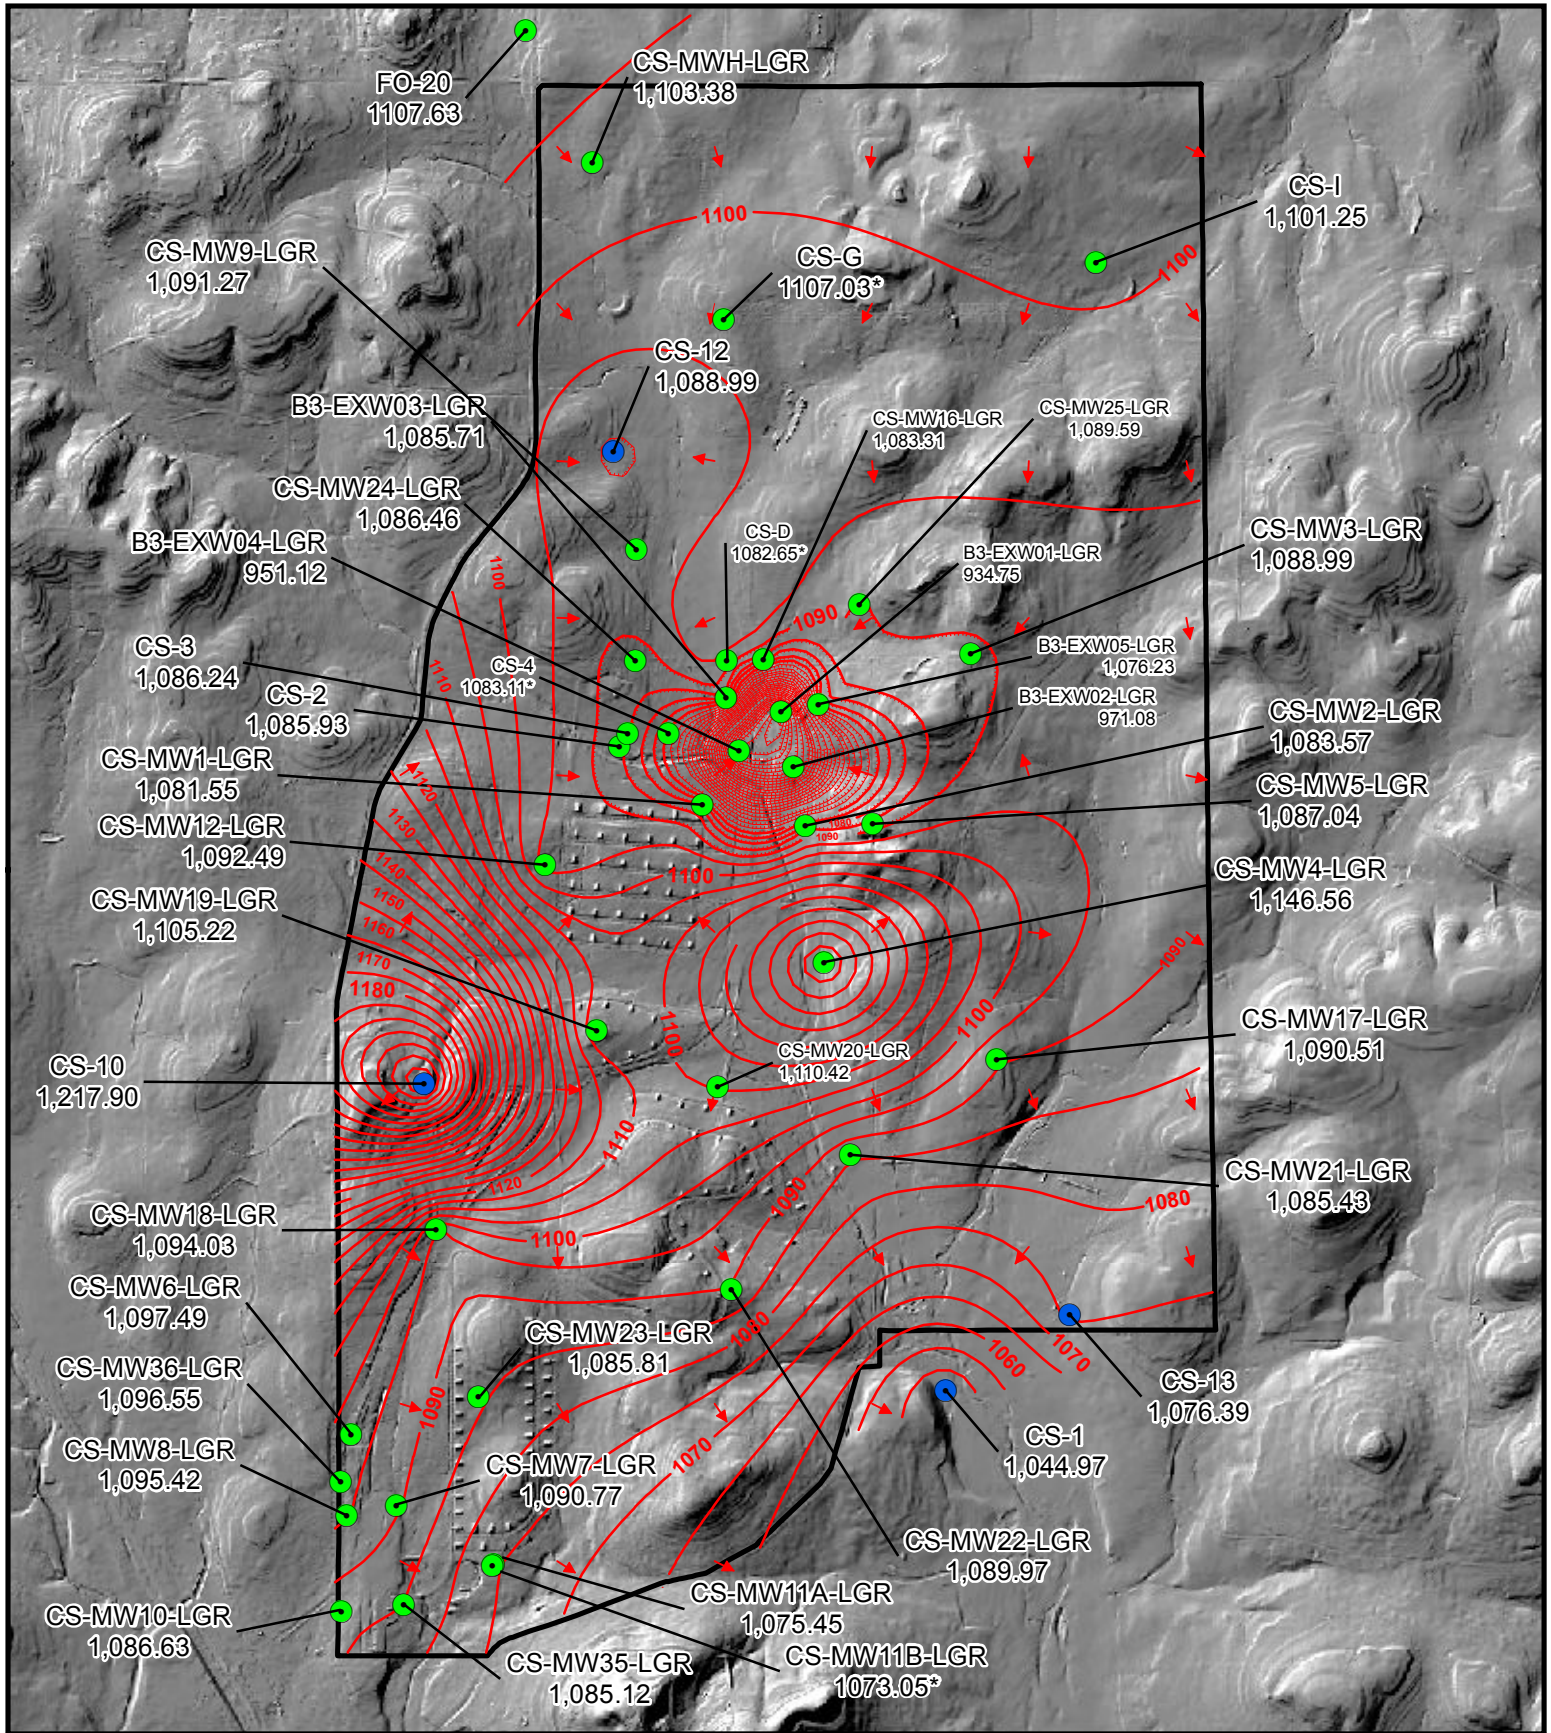

FO-20 1107.63

CS-MWH-LGR 1,103.38

CS-I 1,101.25

CS-MW9-LGR 1,091.27

CS-G 1107.03*

CS-12 1,088.99

B3-EXW03-LGR 1,085.71

CS-MW16-LGR 1,083.31

CS-MW25-LGR 1,089.59

CS-MW24-LGR 1,086.46

CS-D 1082.65*

B3-EXW01-LGR 934.75

CS-MW3-LGR 1,088.99

B3-EXW04-LGR 951.12

B3-EXW05-LGR 1,076.23

B3-EXW02-LGR 971.08

CS-3 1,086.24

CS-4 1083.11*

CS-MW1-LGR 1,081.55

CS-2 1,085.93

CS-MW2-LGR 1,083.57

CS-MW5-LGR 1,087.04

CS-MW12-LGR 1,092.49

CS-MW4-LGR 1,146.56

CS-MW19-LGR 1,105.22

CS-MW20-LGR 1,110.42

CS-MW17-LGR 1,090.51

CS-10 1,217.90

CS-MW21-LGR 1,085.43

CS-MW18-LGR 1,094.03

CS-MW6-LGR 1,097.49

CS-MW13 1,076.39

CS-MW36-LGR 1,096.55

CS-MW23-LGR 1,085.81

CS-MW7-LGR 1,090.77

CS-1 1,044.97

CS-MW8-LGR 1,095.42

CS-MW11A-LGR 1,075.45

CS-MW22-LGR 1,089.97

CS-MW10-LGR 1,086.63

CS-MW35-LGR 1,085.12

CS-MW11B-LGR 1073.05*

- Flow direction
- LGR Groundwater Contours
- Outer fence
- LGR Wells and groundwater elevation (ft above msl)
- Drinking water wells (may be completed in LGR, BS, and/or CC)



* Not a fully penetrating well into LGR. Groundwater elevation not used in contouring



0 0.5 Miles

Figure 2.1
 March 2017 Potentiometric Surface Map, LGR Wells
 Camp Stanley Storage Activity



PARSONS

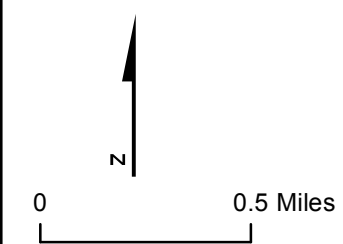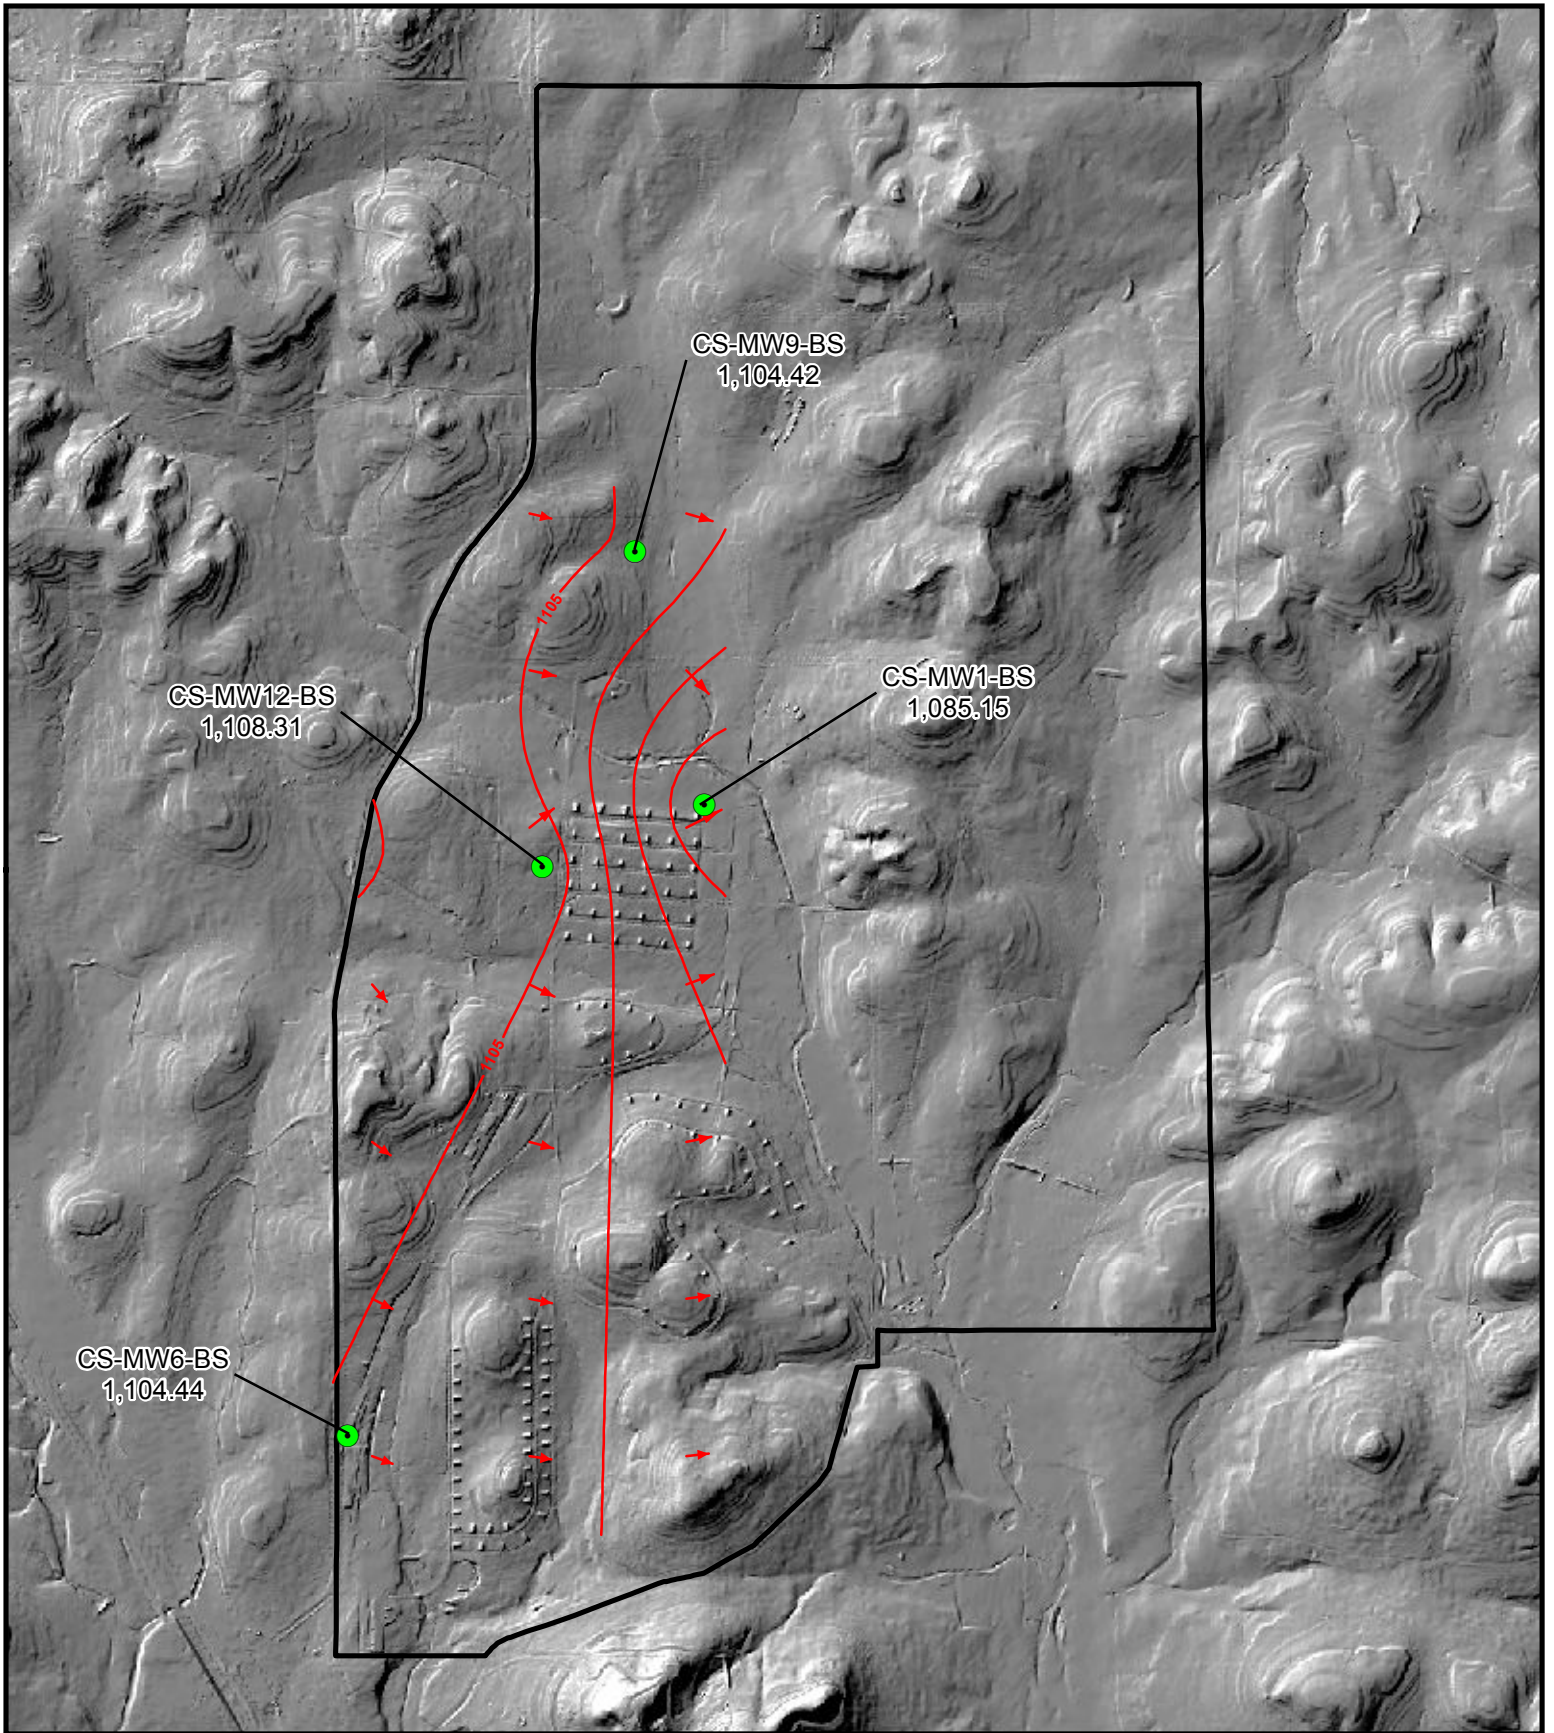

- Flow direction
- Outer fence
- BS Groundwater Contours
- BS Wells and groundwater elevation (ft above msl)

Figure 2-2
 March 2017 Potentiometric
 Surface Map, BS Wells
 Camp Stanley Storage Activity

PARSONS

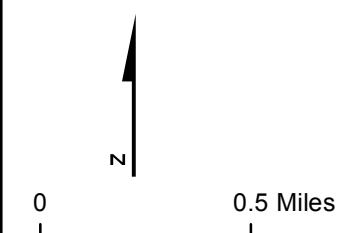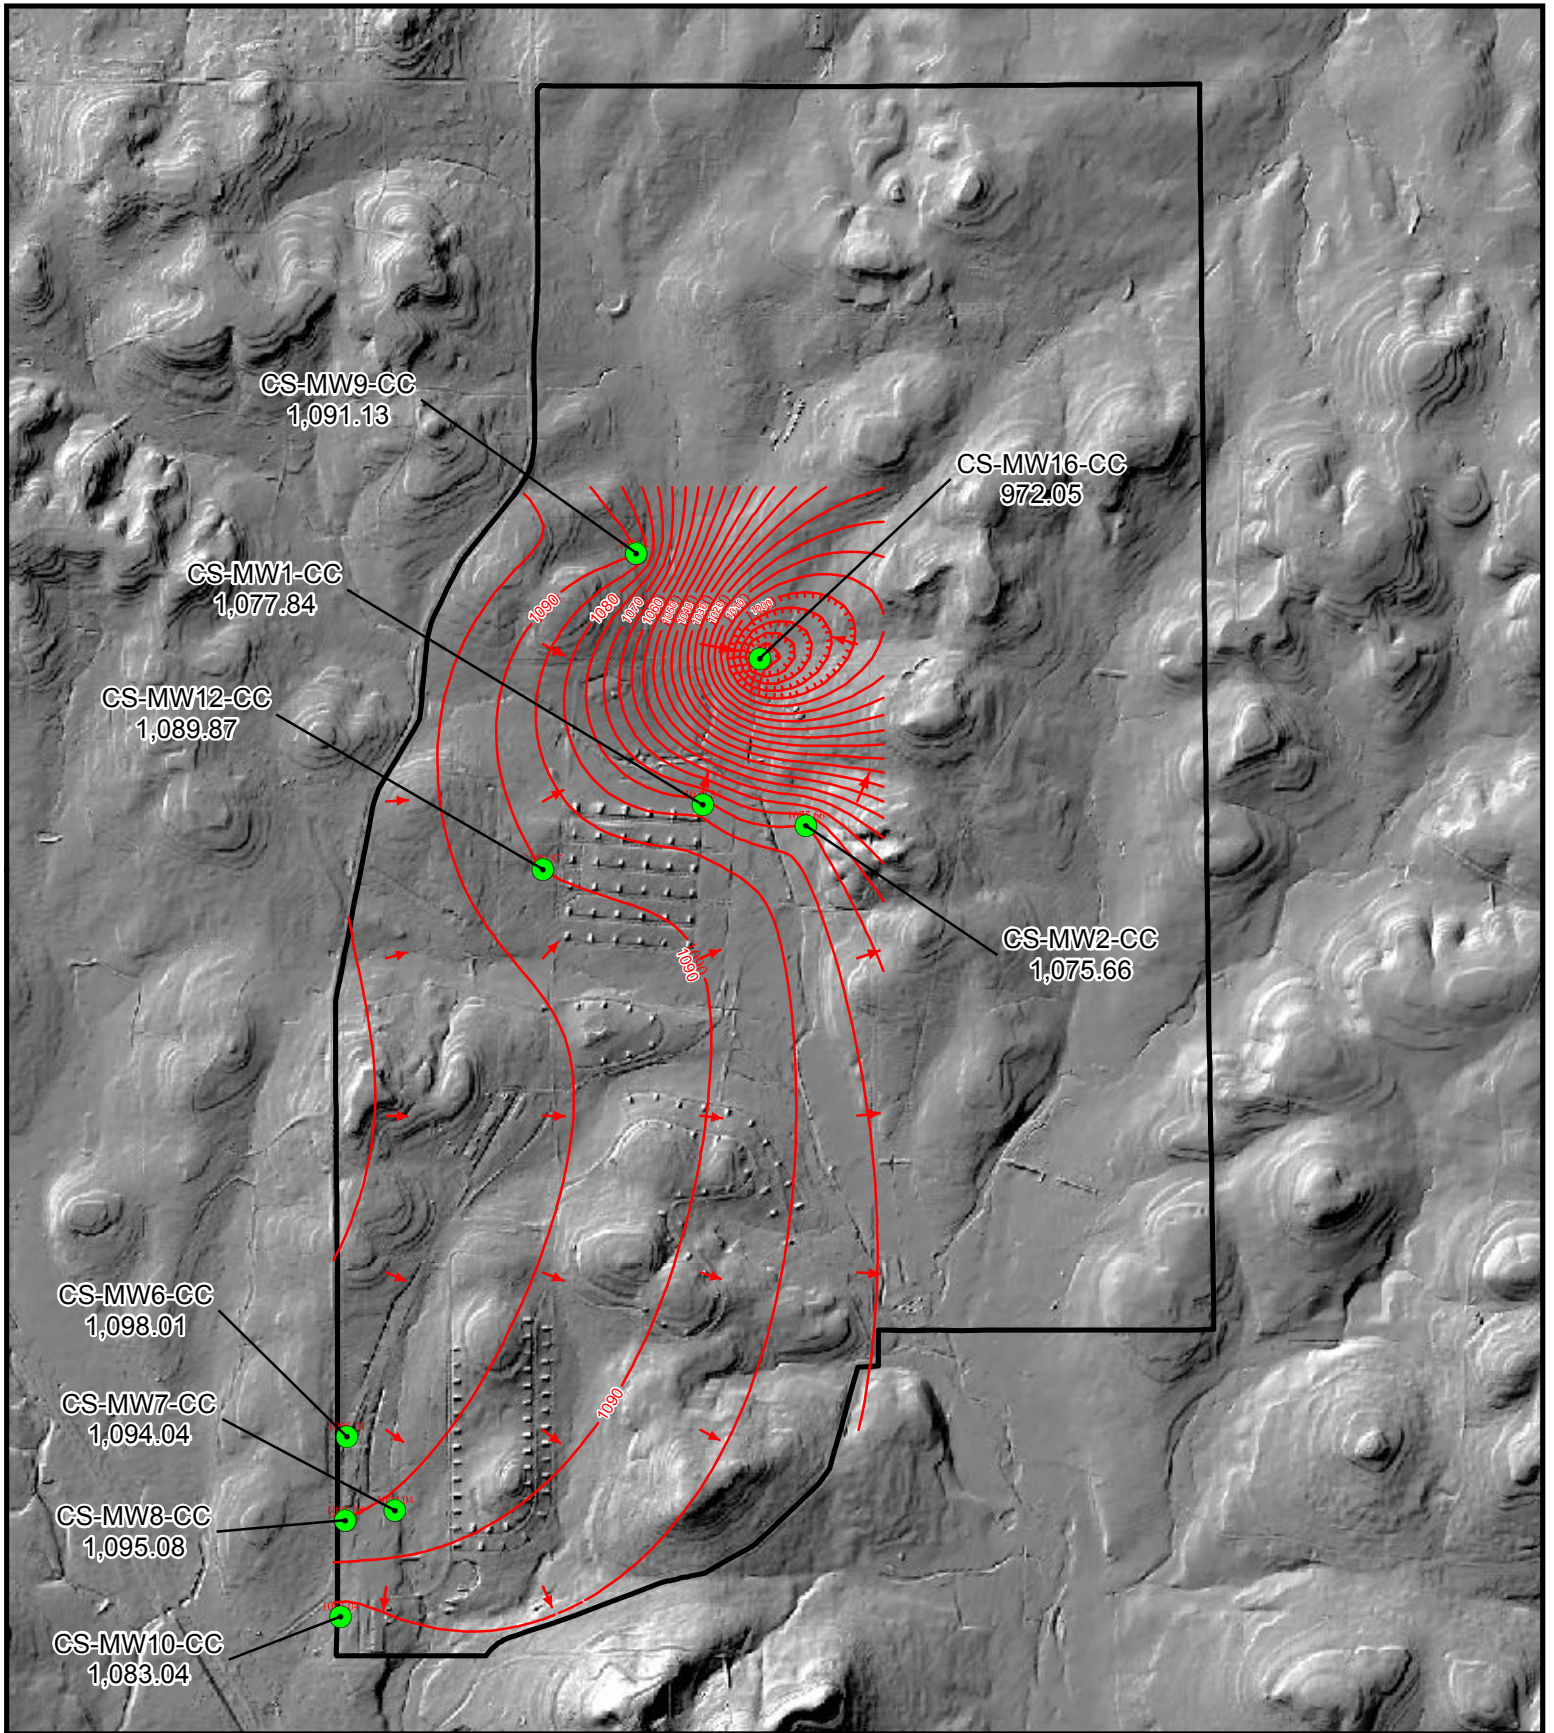





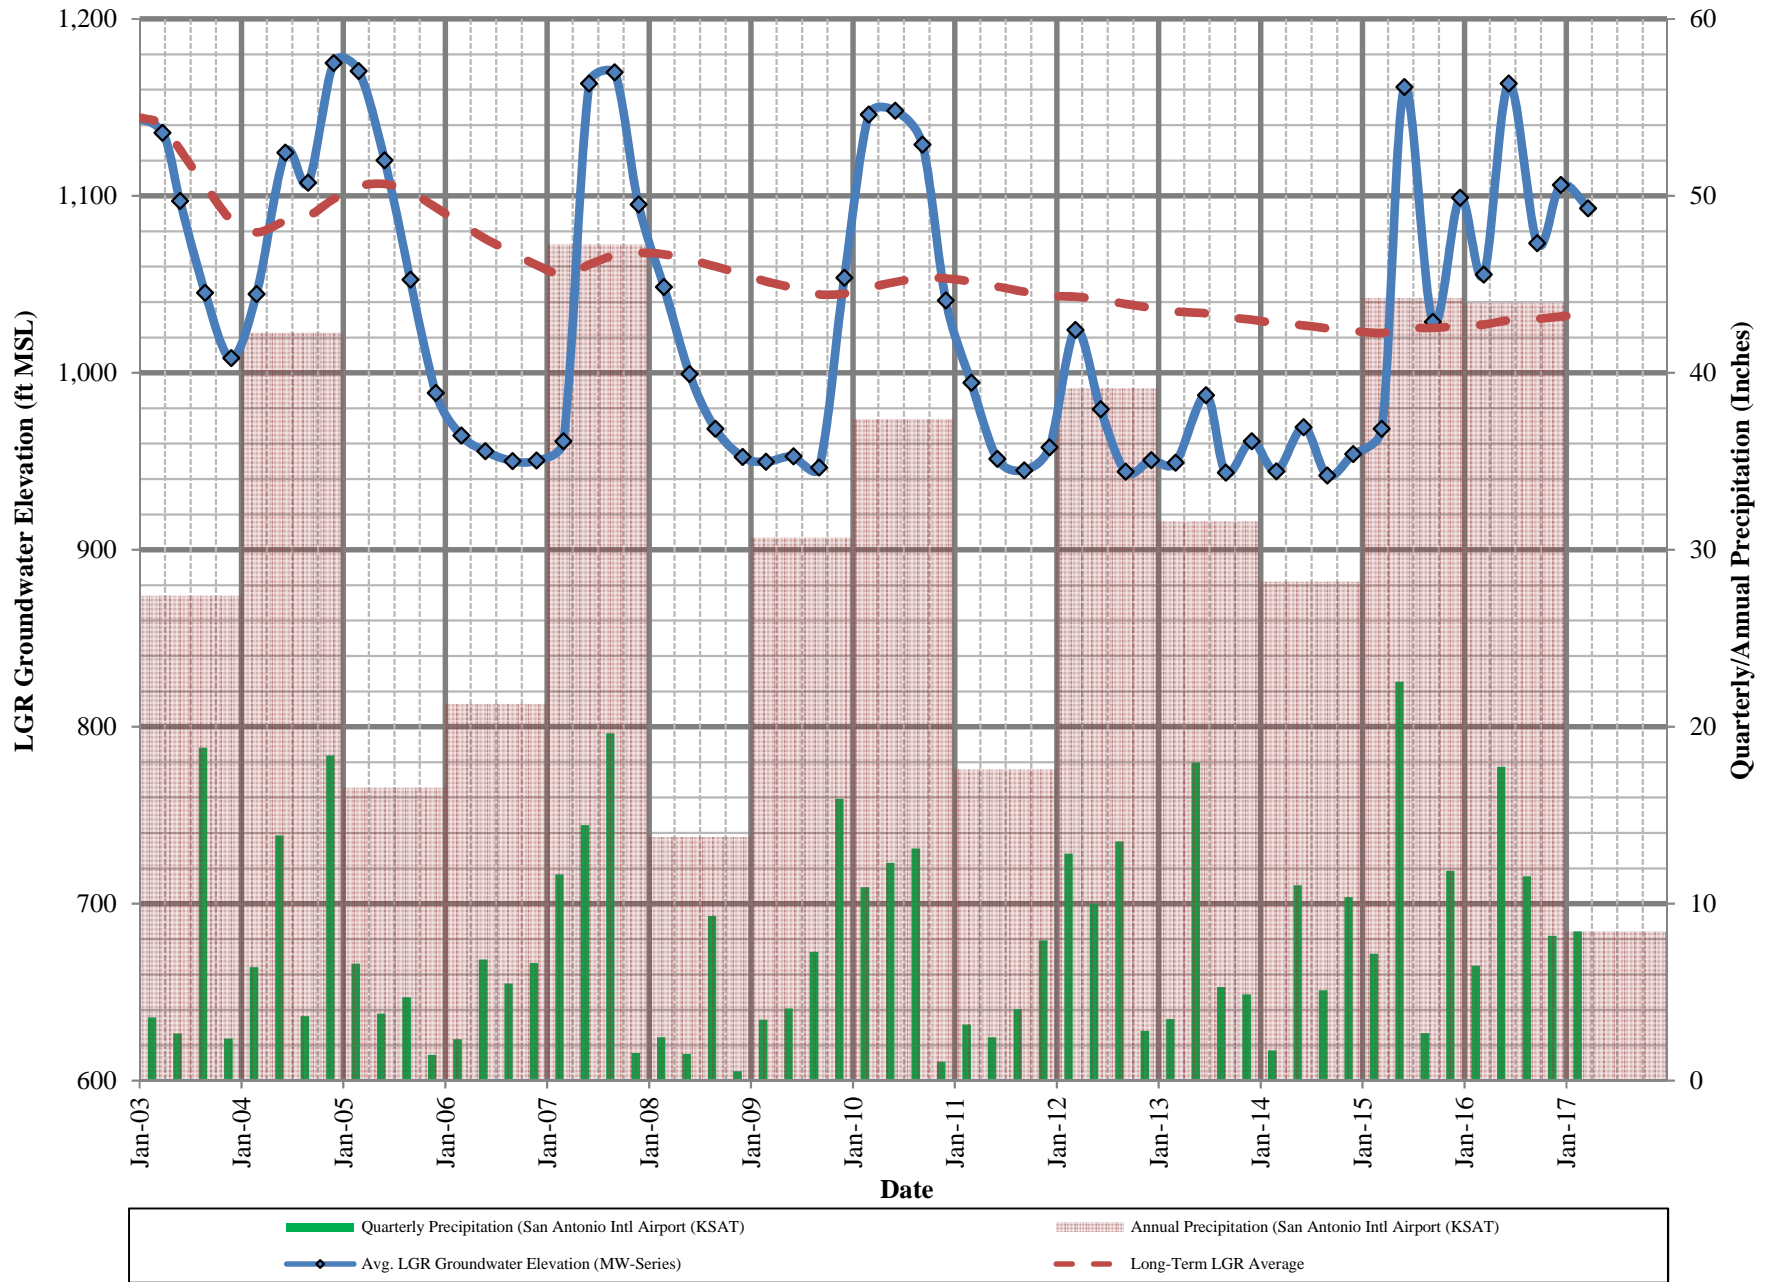
-  Flow direction
-  Outer fence
-  CC Groundwater Contours
-  CC Wells and groundwater elevation (ft above msl)

Figure 2-3
 March 2017 Potentiometric
 Surface Map, CC Wells
 Camp Stanley Storage Activity

PARSONS

Figure 2.4 - Average LGR Groundwater Elevations and Quarterly/Annual Precipitation



It should be noted that well pumping on and around CSSA affects the potentiometric surface. On-post wells CS-MW16-LGR, CS-MW16-CC, B3-EXW01, B3-EXW02, B3-EXW03, B3-EXW04, and B3-EXW05 are cyclically pumped as part of the Bioreactor remediation system at Solid Waste Management Unit (SWMU) B-3. These remediation wells provide groundwater to the Bioreactor system, and are automatically operated based upon water level within each well and availability within the storage tanks. Influences from the pumping of the Bioreactor wells B3-EXW01 through B3-EXW05 are manifested as “cones of depression” in **Figure 2.1**. The Bioreactor cone of depression is induced into the aquifer to extract contaminated water within its direct zone of influence, and otherwise retard the flow of the groundwater that cannot be directly captured by the extraction wells away from the site.

CSSA drinking water wells CS-1, CS-10, and CS-12 are also cycled on and off to maintain the drinking water system currently in place at CSSA. Off-post water supply wells along Ralph Fair Road may also exert a subtle influence to gradients along the western and southern boundaries of the post. In fact, the northern end of CSSA exhibits a southwesterly gradient from well CS-I towards CS-12. In the central portion of CSSA, two groundwater mounds centered on wells CS-10 and CS-MW4-LGR create two areas of radial flow separated by a trough of lower groundwater elevations at wells CS-MW19-LGR and CS-MW20-LGR. The mounding at CS-10 is likely the product erroneous data obtained by CSSA's SCADA system rather than a record of actual groundwater elevation at this well. Supply well CS-10 typically exhibits slightly depressed groundwater elevations rather than mounding, which is contradictory during pumping. Historically, and more typically, a westerly gradient between the groundwater mound at CS-MW4-LGR and supply well CS-10 is observed. In the southern end of the base, the typical south-southeasterly groundwater gradient is evident.

Historical groundwater monitoring at CSSA has demonstrated that the aquifer gradient typically slopes in a south-southeast direction; however, variable aquifer levels and well-pumping scenarios can affect the localized and regional gradients (**Figure 2.1**). In particular, pumping action at wells CS-1, CS-10, CS-12, CS-MW16-LGR/CC, B3-EXW01 through B3-EXW05, CS-MWH-LGR, CS-I, and even off-post wells (Fair Oaks Ranch) can significantly alter the LGR groundwater gradient. The regional gradient calculation, an overall groundwater gradient averaged across CSSA, is measured from CS-MWH-LGR to CS-MW21-LGR (0.001314 ft/ft). North Pasture groundwater from CS-I flows towards CS-12 at a gradient of 0.001888 ft/ft. Localized gradients of 0.0136 ft/ft to the east were measured between CS-MW4-LGR and CS-10, however the groundwater elevation data for CS-10 is suspected to be in error. A south-southeasterly gradient of 0.0127 ft/ft was present between CS-MW21-LGR and CS-1 at the southern end of the camp.

Under normal conditions, the potentiometric surface in both the BS and CC members of the aquifer generally trend in a southerly direction, like the LGR. But during periods of above-average water levels or intense aquifer recharge, a strongly dominant eastward component in both the BS and CC is often observed (**Figures 2.2 and 2.3**). The BS potentiometric surface has a distinctly easterly gradient towards CS-MW1-BS (**Figure 2.2**), with an average groundwater elevation of 1,100.58 feet MSL. Likewise, the CC potentiometric surface has an easterly gradient with an average elevation of 1,075.19 feet MSL.

A review of historical data has shown that the CC potentiometric surface develops a predominantly easterly gradient when the average CC groundwater elevation is higher than 995

feet MSL. Below that elevation, the gradient resumes a more southerly direction. Notable for March 2017 is the well-developed cone of depression around the Bioreactor extraction well, CS-MW16-CC. That well is used for continuous groundwater extraction for the SWMU B-3 Bioreactor system. Similar groundwater conditions were last seen during the September 2016 event, where the CC aquifer also showed a predominantly east-southeasterly flow gradient which is interrupted by a well-developed cone of depression around well CS-MW16-CC.

Groundwater elevations have been measured and recorded since 1992. Previous droughts resulted in water levels decreasing substantially in 1996, 1999, 2000, 2006, 2008, 2009, 2011 through 2014. In 2015, approximately 44 inches of rainfall in the San Antonio area ended the drought cycle, resulting in a net gain of 145 feet in aquifer level over the course of the year. Through March 2017, approximately 8.5 inches of rainfall has been realized in the San Antonio area. By the end of March 2017, the postwide average level in the LGR wells decreased approximately 13 feet from December 2016. With this decrease, the March 2017 LGR groundwater average elevation (1,092.92 feet MSL) is now 60 feet above the long-term (14.25 year) average groundwater elevation (1,032.89 feet MSL).

It is worth noting that, based on more than 14 years of program history, the postwide LGR groundwater level has declined by 115 feet (see **Figure 2.4**). As can be expected with sparse data sets, the largest rate of change/decline (90 feet) came during the initial 4 years of the groundwater monitoring program. Over the past 9 years, the average decline rate has subdued, losing an additional 30 feet of average groundwater elevation over 7 years of prolonged drought (with the exception of 2010). The past 14.25-year history of CSSA groundwater monitoring indicates that the aquifer level is “below average” approximately 66 percent of the time. However, the past seven monitoring events (June, September, December 2015 and March, June, September, December 2016, and March 2017) have shown above-average aquifer levels. Above average groundwater elevations have been recorded only ten times in the past 28 monitoring events (7 years). Prior to June 2015, the LGR had not been above the long-term “average” water elevation since September 2010.

3.0 MARCH ANALYTICAL RESULTS

3.1 Monitoring Wells

Under the provisions of the groundwater monitoring DQOs and the 2015 LTMO evaluation, the schedule for sampling on-post in March 2017 included 4 wells. The samples included three production wells (CS-1, CS-10, and CS-12), and one future production well (CS-13) (see **Table 3.1**). In conjunction with the off-post monitoring initiative (under a separate report) the March 2017 groundwater sampling constituted a “quarterly” event as outlined in the 2015 LTMO updated schedule, which was implemented in December 2016.

Three of the 4 wells scheduled for monitoring in March 2017 were sampled. One well CS-13 was not sampled due to well house construction. Additional samples were collected as part of the AOC-65 in-situ chemical oxidation (ISCO) and SWMU B-3 bioreactor Corrective Measures; these results will be reported in separate reports. **Tables 3.1** and **3.2** provide a sampling overview for March 2017 and the schedule under the LTMO recommendations. The wells listed in **Table 3.1** are sampled using dedicated low-flow gas-operated bladder pumps. Wells CS-1, CS-10, CS-12, and CS-13 were sampled using dedicated electric submersible pumps. **Figure 3.1** shows well sampling locations.

Wells sampled by low-flow pumps were purged until the field parameters of pH, temperature, and conductivity stabilized. The on-post monitoring wells were sampled in March 2017 for volatile organic compounds (VOCs) analytes which include *cis*-1,2-dichloroethene (*cis*-1,2-DCE), tetrachloroethene (PCE), trichloroethene (TCE), and vinyl chloride. Effective in September 2016 per the recently-approved DQOs, metals are no longer obtained from on-post monitoring wells. Metals analyses will continue to be collected from wells at active groundwater remediation sites (AOC-65 and B-3), as well as on-post drinking water wells. As such, active and future drinking water wells CS-1, CS-10, CS-12, and CS-13 were analyzed for the same VOC analytes and metals (arsenic, barium, chromium, copper, zinc, cadmium, mercury, and lead).

Samples were analyzed by Agriculture & Priority Pollutant Laboratories (APPL) in Clovis, California. All detected concentrations of VOCs and metals are presented in **Table 3.3**. Full analytical results are presented in **Appendix B**.

No VOCs were detected above the Maximum Contaminant Level (MCL) of 5 micrograms per liter ($\mu\text{g/L}$) in wells sampled this quarter. A comparison of VOC concentrations versus water level for select wells is presented in **Figure 3.2**. Although not sampled this quarter, the overall trend for select wells (CS-D, CS-4, CS-MW1-LGR, CS-MW5-LGR, CS-MW36-LGR) sampled in September 2016 indicate a decrease in VOC concentrations with a decrease in groundwater elevation. CS-MW5-LGR has been sampled since 2001, but it has only recently (December 2015) shown concentrations of PCE and TCE above the MCL.

**Table 3.1
Overview of the On-Post Monitoring Program**

| Count | Well ID | Analytes | Last Sample Date | Jun-16 | Sep-16 (transition event) | Dec-16 | Mar-17 | Sampling Frequency* |
|-------|--------------|--|------------------|--------|------------------------------|---------|--------|-------------------------------|
| | CS-MW1-LGR | VOCs | Sep-16 | NS | S | NS | NS | 15 months / semi annual B-3 |
| | CS-MW1-BS | VOCs | Dec-12 | NS | NS | NS | NS | as needed |
| | CS-MW1-CC | VOCs | Dec-15 | NS | NS | NS | NS | 30 months |
| | CS-MW2-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW2-CC | VOCs | Dec-15 | NS | NS | NS | NS | 30 months |
| | CS-MW3-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW4-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW5-LGR | VOCs | Sep-16 | S | S | NS | NS | 15 months / semi annual B-3 |
| | CS-MW6-LGR | VOCs | Sep-16 | NS | S | NS | NS | 15 months GW / Qtrly ISCO |
| | CS-MW6-BS | VOCs | Dec-12 | NS | NS | NS | NS | as needed |
| | CS-MW6-CC | VOCs | Dec-15 | NS | NS | NS | NS | 30 months |
| | CS-MW7-LGR | VOCs | Sep-16 | NS | S | NS | NS | 15 months GW / Qtrly ISCO |
| | CS-MW7-CC | VOCs | Dec-15 | NS | NS | NS | NS | 30 months |
| | CS-MW8-LGR | VOCs | Sep-16 | NS | S | NS | NS | 15 months GW / Qtrly ISCO |
| | CS-MW8-CC | VOCs | Dec-15 | NS | NS | NS | NS | 15 months |
| | CS-MW9-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW9-BS | VOCs | Dec-12 | NS | NS | NS | NS | as needed |
| | CS-MW9-CC | VOCs | Dec-15 | NS | NS | NS | NS | 30 months |
| | CS-MW10-LGR | VOCs | Sep-16 | NS | S | NS | NS | 15 months |
| | CS-MW10-CC | VOCs | Dec-15 | NS | NS | NS | NS | 30 months |
| | CS-MW11A-LGR | VOCs | Sep-16 | NS | S | NS | NS | 15 months |
| | CS-MW11B-LGR | VOCs | Sep-16 | NS | S | NS | NS | 15 months |
| | CS-MW12-LGR | VOCs | Sep-16 | NS | S | NS | NS | 15 months |
| | CS-MW12-BS | VOCs | Dec-12 | NS | NS | NS | NS | as needed |
| | CS-MW12-CC | VOCs | Dec-15 | NS | NS | NS | NS | 30 months |
| | CW-MW17-LGR | VOCs | Sep-16 | NS | S | NS | NS | 15 months |
| | CS-MW18-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW19-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| 1 | CS-1 | VOCs & metals (As,Ba,Cr, Cu,Cd,Hg,Pb,Zn) | Dec-16 | S | S | S | S | Quarterly |
| | CS-2 | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-4 | VOCs | Sep-16 | NS | S | NS | NS | 15 months |
| 2 | CS-10 | VOCs & metals (As,Ba,Cr, Cu,Cd,Hg,Pb,Zn) | Dec-16 | S | S | S | S | Quarterly |
| 3 | CS-12 | VOCs & metals (As,Ba,Cr, Cu,Cd,Hg,Pb,Zn) | Dec-16 | S | S | S | S | Quarterly |
| 4 | CS-13 | VOCs & metals (As,Ba,Cr, Cu,Cd,Hg,Pb,Zn) | Sep-16 | S | S | offline | S | Quarterly |
| | CS-D | VOCs | Sep-16 | NS | S | NS | NS | 15 months GW / semi annual B3 |
| | CS-MWG-LGR | VOCs | Dec-15 | NS | NS | NS | NS | 30 months |
| | CS-MWH-LGR | VOCs | Dec-15 | NS | NS | NS | NS | 30 months |
| | CS-I | VOCs | Dec-15 | NS | NS | NS | NS | 30 months |
| | CS-MW20-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW21-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW22-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW23-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW24-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW25-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW35-LGR | VOCs | Sep-16 | NS | S | NS | NS | 30 months |
| | CS-MW36-LGR | VOCs | Sep-16 | S | S | NS | NS | 15 months GW / Qtrly ISCO |

* New LTMO sampling frequency to be implemented in December 2016

S = Sample

NS = No Sample

NSWL = No Sample due to low water level

Table 3.2 Westbay Sampling Frequency


| Westbay Interval | Last Sample Date | Jun-16 (9 month) | Sep-16 (transition event) | Dec-16 | Mar-17 | LTMO Sampling Frequency (as of Dec. 2016) |
|------------------|------------------|------------------|---------------------------|--------|--------|---|
| CS-WB01-UGR-01 | Dec-04 | NSWL | NSWL | NS | NS | 15 months GW/Qtrly ISCO |
| CS-WB01-LGR-01 | Sep-16 | S | S | NS | NS | 15 months GW/Qtrly ISCO |
| CS-WB01-LGR-02 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB01-LGR-03 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB01-LGR-04 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB01-LGR-05 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB01-LGR-06 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB01-LGR-07 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB01-LGR-08 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB01-LGR-09 | Sep-16 | S | S | NS | NS | 15 months GW/Qtrly ISCO |
| CS-WB02-UGR-01 | Dec-04 | NS | NS | NS | NS | port clogged, no sample |
| CS-WB02-LGR-01 | Dec-14 | NSWL | NSWL | NS | NS | 15 months GW/Qtrly ISCO |
| CS-WB02-LGR-02 | Mar-10 | NSWL | NSWL | NS | NS | 15 months |
| CS-WB02-LGR-03 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB02-LGR-04 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB02-LGR-05 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB02-LGR-06 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB02-LGR-07 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB02-LGR-08 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB02-LGR-09 | Sep-16 | S | S | NS | NS | 15 months GW/Qtrly ISCO |
| CS-WB03-UGR-01 | Sep-16 | S | S | NS | NS | 15 months GW/Qtrly ISCO |
| CS-WB03-LGR-01 | Sep-16 | S | S | NS | NS | 15 months GW/Qtrly ISCO |
| CS-WB03-LGR-02 | Oct-07 | NSWL | NSWL | NS | NS | 15 months |
| CS-WB03-LGR-03 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB03-LGR-04 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB03-LGR-05 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB03-LGR-06 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB03-LGR-07 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB03-LGR-08 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB03-LGR-09 | Sep-16 | S | S | NS | NS | 15 months GW/Qtrly ISCO |
| CS-WB04-UGR-01 | Mar-04 | NSWL | NSWL | NS | NS | 15 months GW/Qtrly ISCO |
| CS-WB04-LGR-01 | Sep-15 | NS | NS | NS | NS | 15 months GW/Qtrly ISCO |
| CS-WB04-LGR-02 | Mar-14 | NS | NS | NS | NS | 15 months |
| CS-WB04-LGR-03 | Sep-15 | NS | NS | NS | NS | 15 months |
| CS-WB04-LGR-04 | Sep-15 | NS | NS | NS | NS | 15 months |
| CS-WB04-LGR-06 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB04-LGR-07 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB04-LGR-08 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB04-LGR-09 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB04-LGR-10 | Sep-16 | S | S | NS | NS | 15 months |
| CS-WB04-LGR-11 | Sep-16 | S | S | NS | NS | 15 months GW/Qtrly ISCO |
| CS-WB04-BS-01 | Sep-15 | NS | NS | NS | NS | 30 months |
| CS-WB04-BS-02 | Sep-15 | NS | NS | NS | NS | 30 months |
| CS-WB04-CC-01 | Sep-15 | NS | NS | NS | NS | 30 months |
| CS-WB04-CC-02 | Sep-15 | NS | NS | NS | NS | 30 months |
| CS-WB04-CC-03 | Sep-15 | NS | NS | NS | NS | 30 months |

Profiling performed quarterly, in conjunction with post wide water levels.

S = Sample

NS = No Sample

NSWL = No sample due to low water level

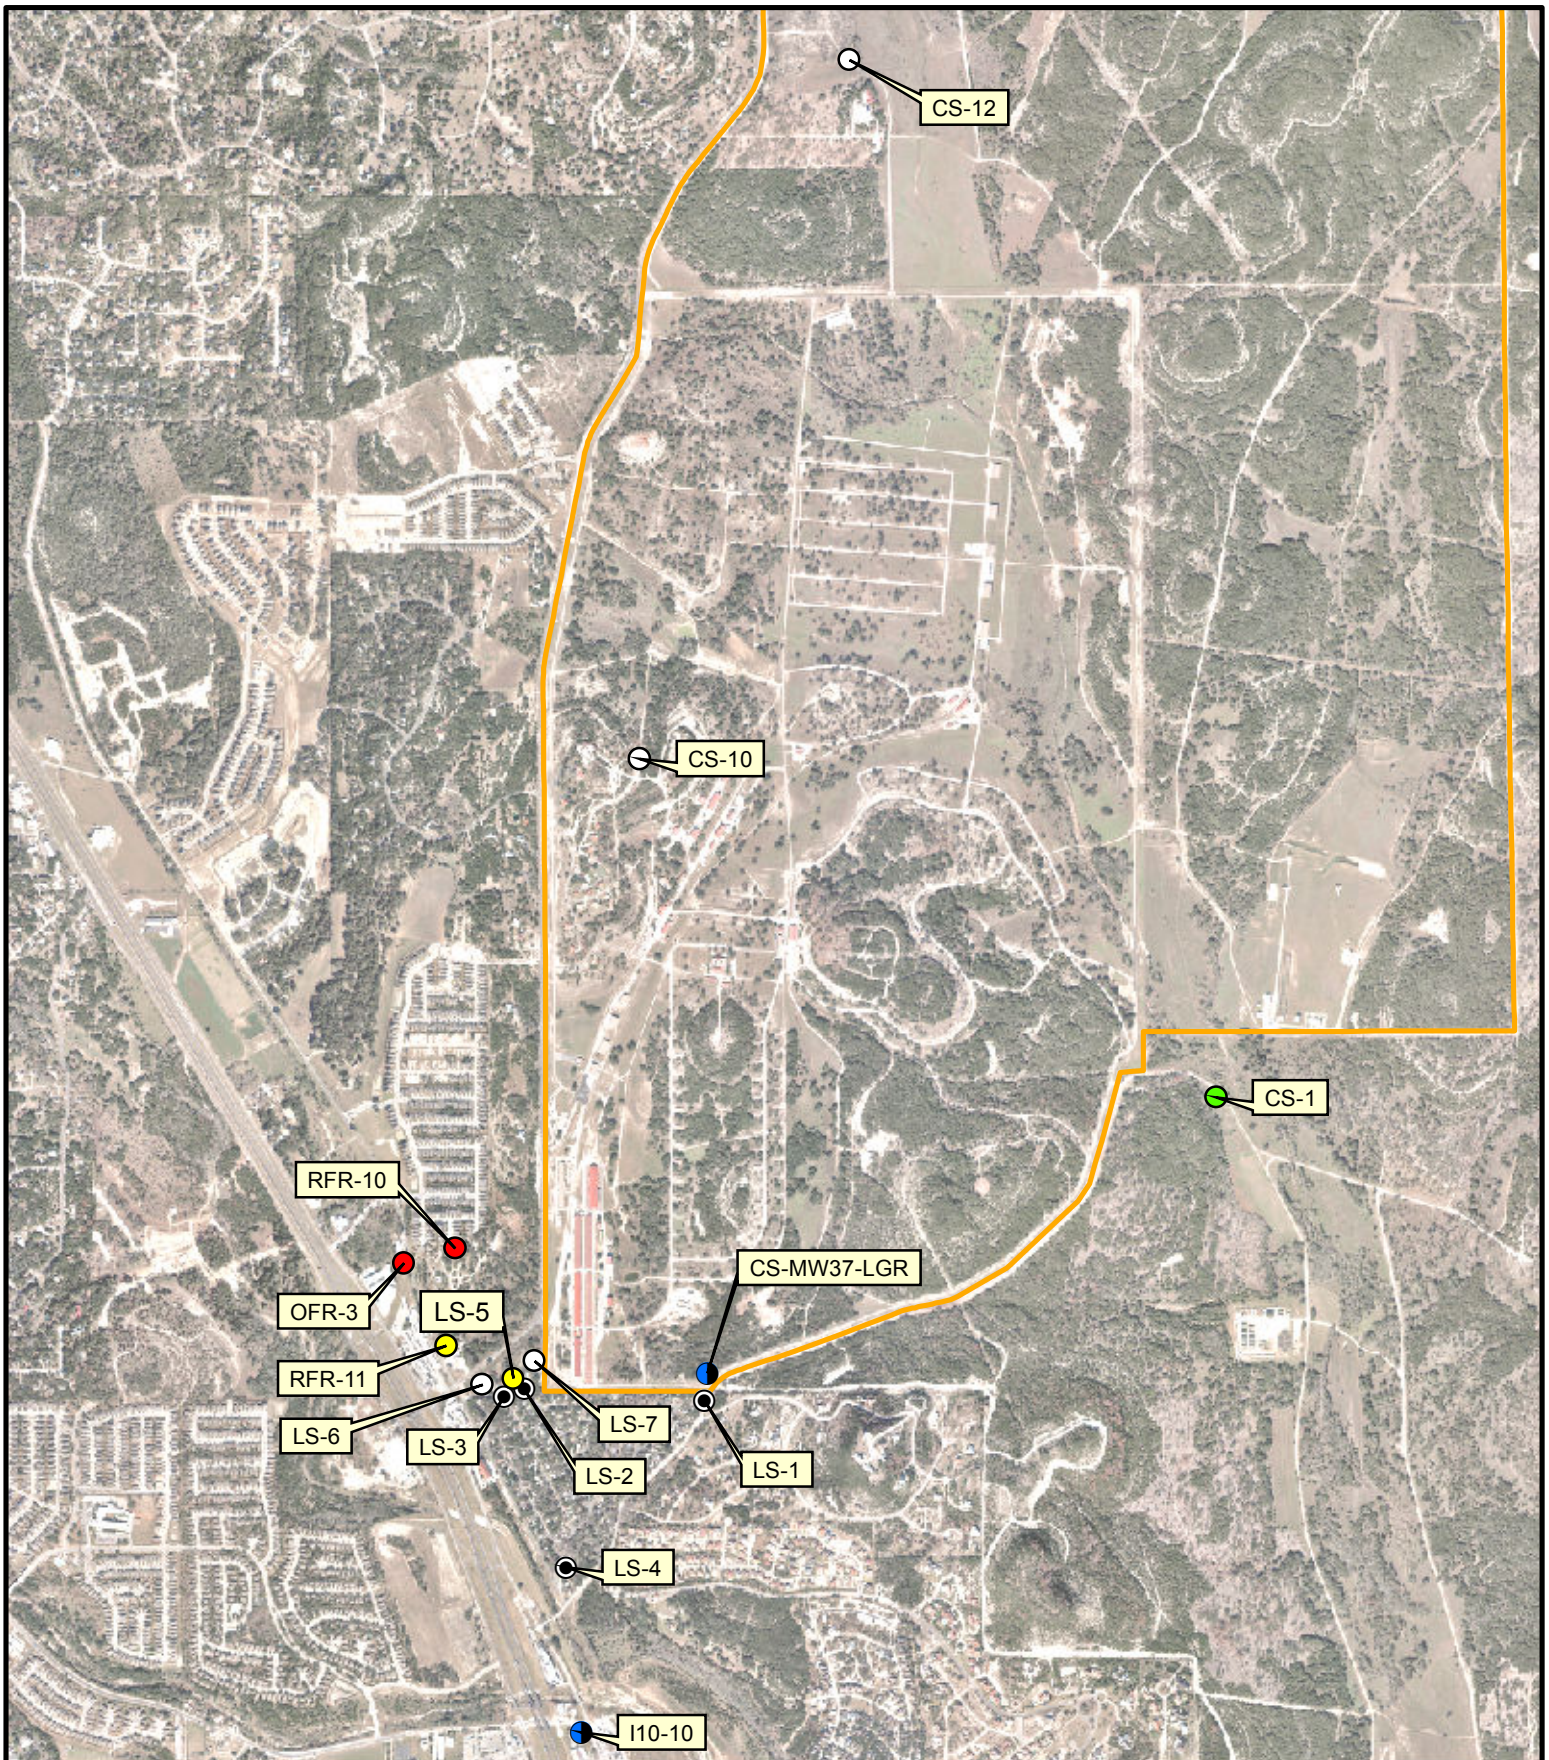

Sampled Wells March 2017

- > MCL (VOC's) only
- > RL (VOC's) only
- > MDL (VOC's) only
- ND
- ⊙ Plugged and Abandoned
- Replacement Well

0 0.25 0.5 Miles

C:\CSA\GIS\MXD\ANNUAL_QW_FACT_SHEET\Mar17_Sampled_Wells_fig_2_1.mxd 5/11/2017 10:44:56 AM wayne.simonbeau@parsons.com

Figure 3-1

On-Post and Off-Post Well Sampling Locations for March 2017
Camp Stanley Storage Activity

PARSONS

Table 3.3
March 2017 On-Post Quarterly Groundwater Results, Detected Analytes

| Well ID | Sample Date | Arsenic | Barium | Cadmium | Chromium | Copper | Lead | Zinc | Mercury |
|--|-------------|----------------|---------------|---------------|----------------|---------------|-----------------|---------------|---------------|
| CSSA Drinking Water Well System | | | | | | | | | |
| CS-1 | 4/4/2017 | 0.0066F | 0.0366 | -- | -- | 0.005F | -- | 0.191 | -- |
| CS-10 | 3/30/2017 | 0.0054F | 0.0396 | -- | 0.0013F | 0.011 | -- | 0.227 | -- |
| CS-12 | 3/30/2017 | 0.0023F | 0.0291 | -- | 0.0012F | -- | -- | 0.028F | -- |
| CS-12 FD | 3/30/2017 | 0.0013F | 0.0284 | -- | -- | -- | -- | 0.025F | -- |
| Comparison Criteria | | | | | | | | | |
| Method Detection Limit (MDL) | | 0.00022 | 0.0003 | 0.0005 | 0.001 | 0.003 | 0.0019 | 0.008 | 0.0001 |
| Reporting Limit (RL) | | 0.03 | 0.005 | 0.007 | 0.01 | 0.01 | 0.025 | 0.05 | 0.001 |
| Max. Contaminant Level (MCL) | | 0.01 | 2 | 0.005 | 0.1 | AL=1.3 | AL=0.015 | SS=5.0 | 0.002 |

| Well ID | Sample Date | cis-1,2-DCE | PCE | TCE | Vinyl Chloride |
|--|-------------|-------------|--------------|-------------|----------------|
| CSSA Drinking Water Well System | | | | | |
| CS-1 | 4/4/2017 | -- | -- | -- | -- |
| CS-10 | 3/30/2017 | -- | 0.18F | -- | -- |
| CS-12 | 3/30/2017 | -- | 0.28F | -- | -- |
| CS-12 FD | 3/30/2017 | -- | 0.19F | -- | -- |
| Comparison Criteria | | | | | |
| Method Detection Limit (MDL) | | 0.07 | 0.06 | 0.05 | 0.08 |
| Reporting Limit (RL) | | 1.2 | 1.4 | 1 | 1.1 |
| Max. Contaminant Level (MCL) | | 70 | 5 | 5 | 2 |

| | |
|-------------|-----------------|
| BOLD | = Above the MDL |
| BOLD | = Above the RL |
| BOLD | = Above the MCL |

| Precipitation per Quarter: | |
|------------------------------------|--------------|
| AOC-65 Weather Station (AOC-65 WS) | Mar-17 NA |
| B-3 Weather Station (B-3 WS) | 7.61 |

All samples were analyzed by APPL, Inc.
 VOC data reported in ug/L & metals data reported in mg/L.








Abbreviations/Notes:

FD Field Duplicate
 TCE Trichloroethene
 PCE Tetrachloroethene
 DCE Dichloroethene
 AL Action Level
 SS Secondary Standard

Data Qualifiers

--The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
 F-The analyte was positively identified but the associated numerical value is below the RL.
 NA - data not available

Figure 2.3
On-Post Cumulative Analytical vs. Groundwater Elevation

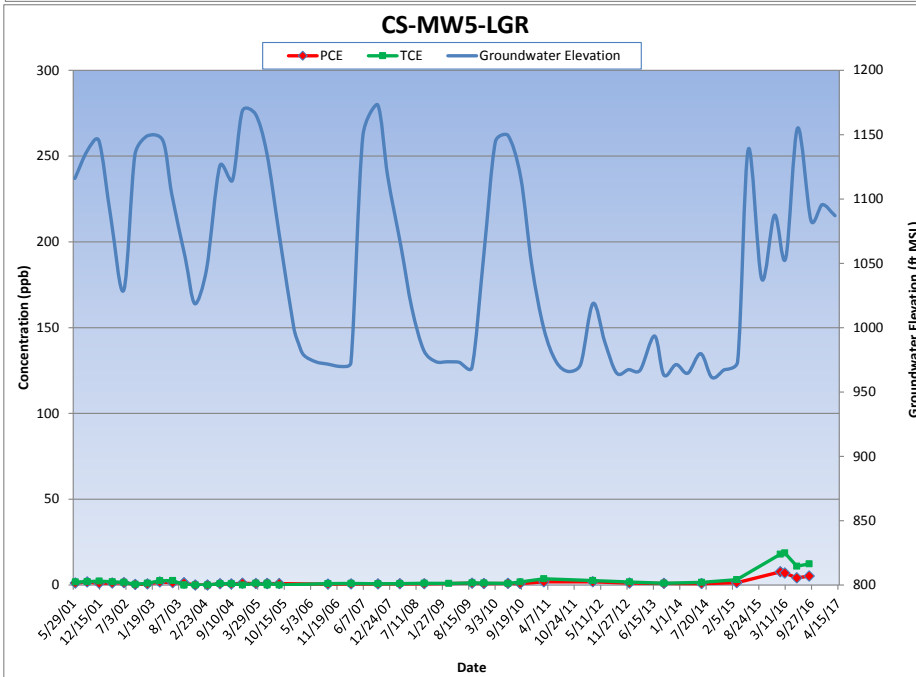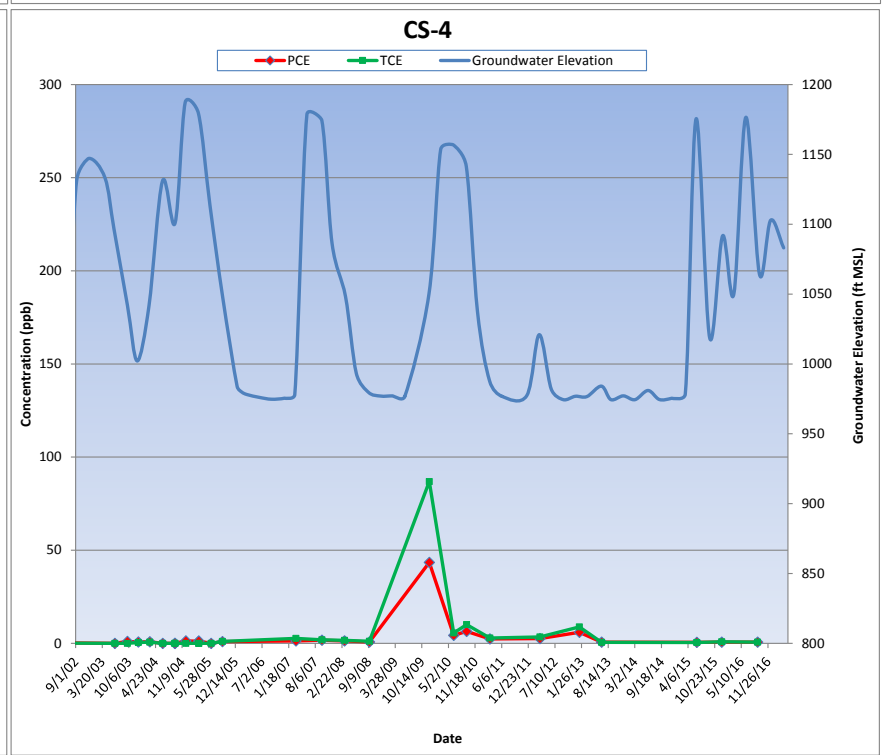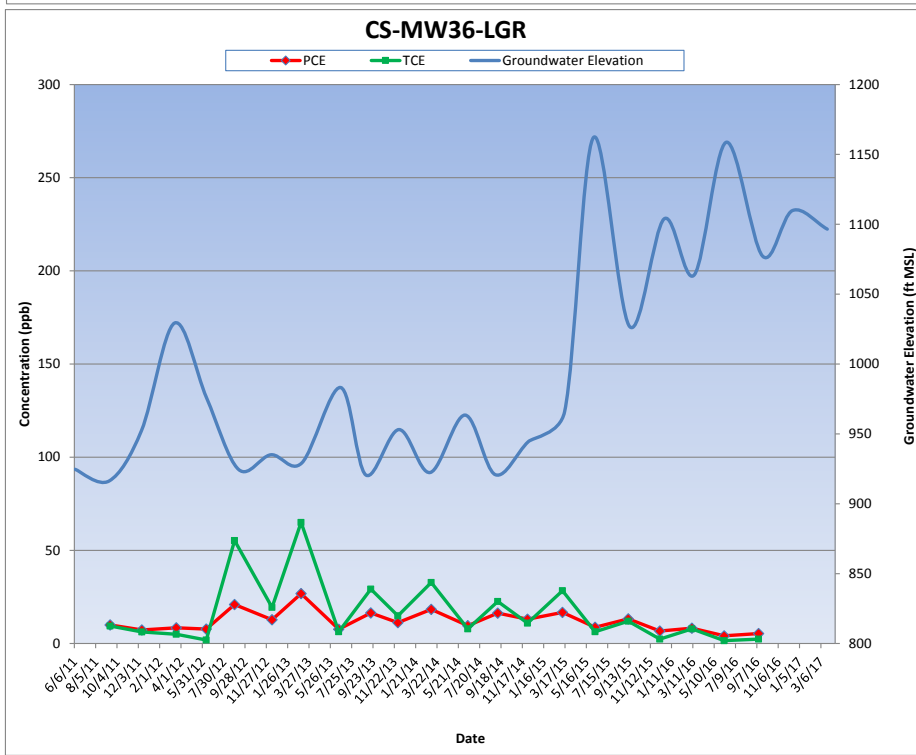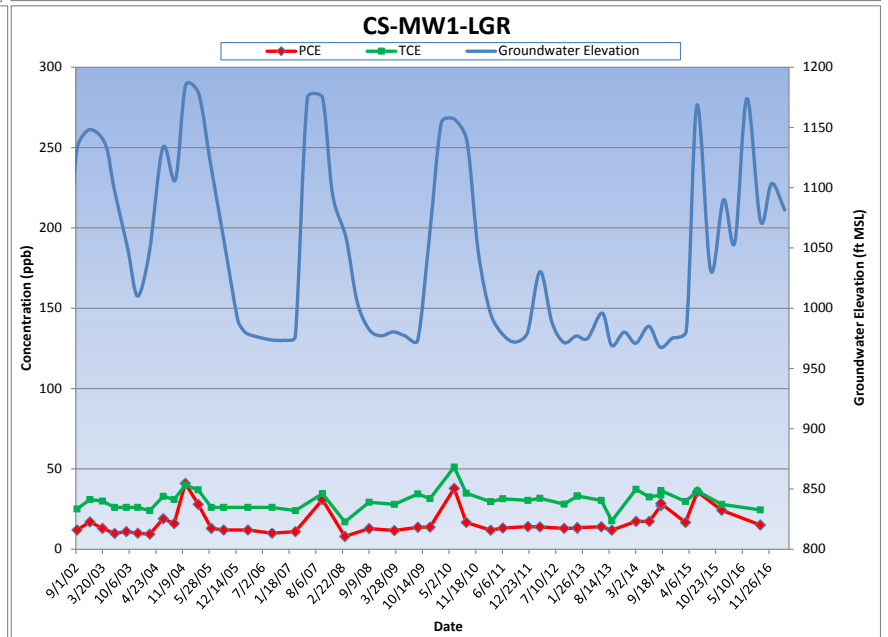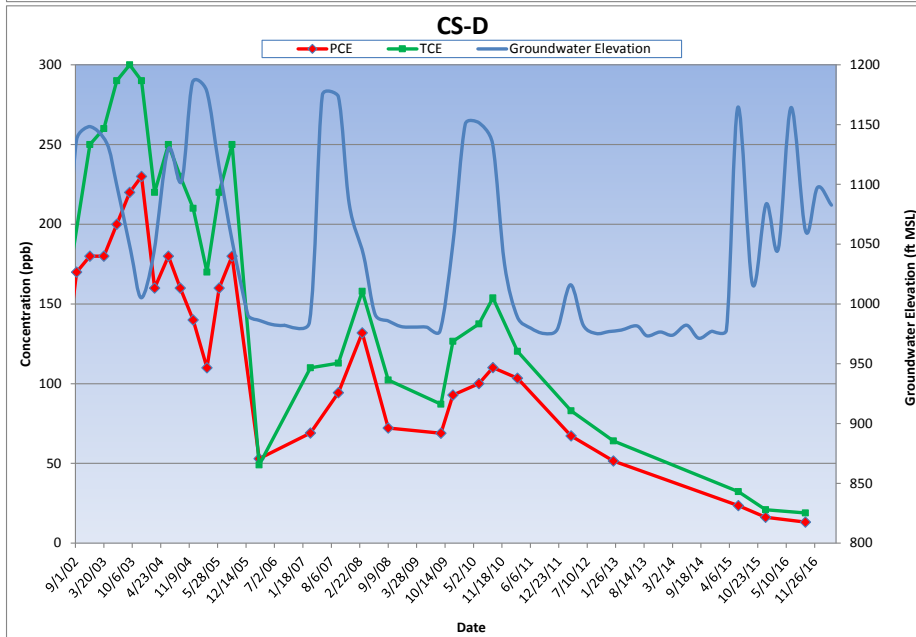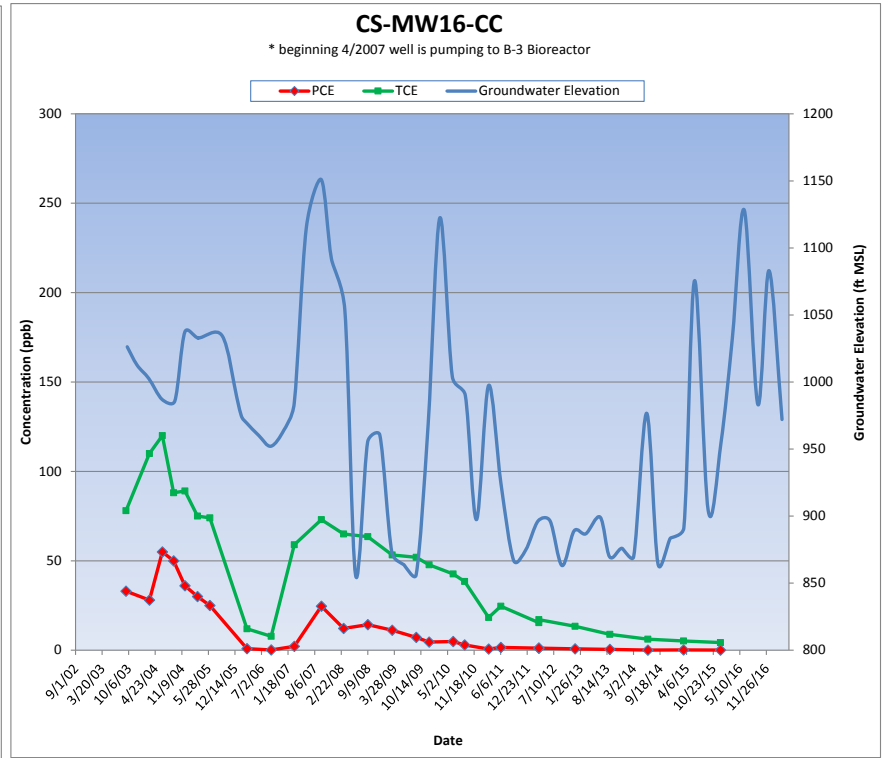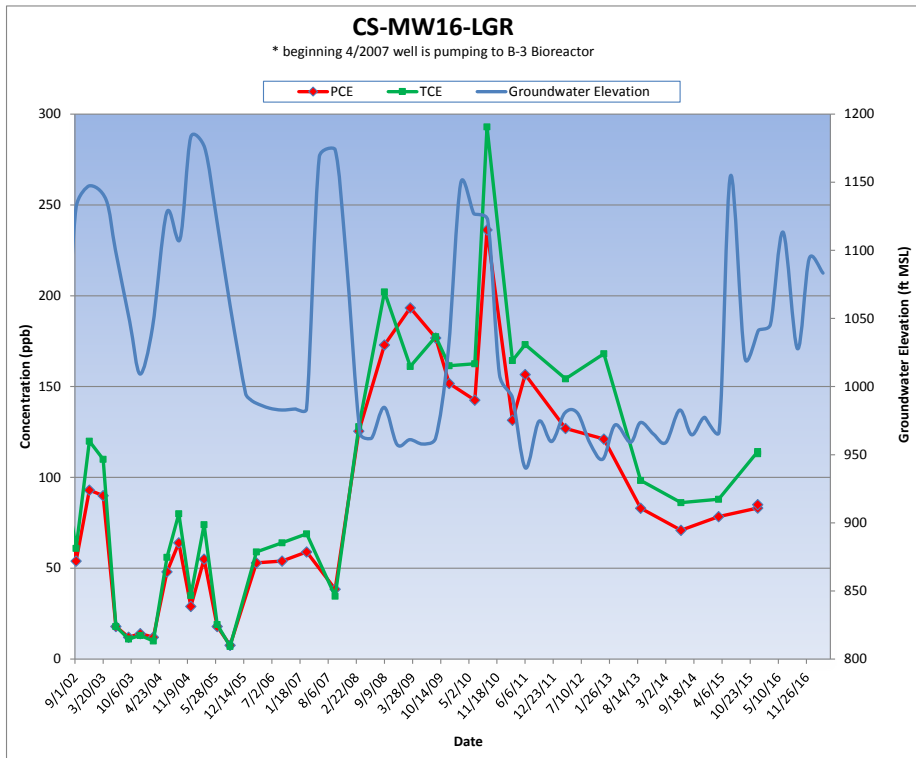

NOTE: Sampling dates are indicated by the squares on the trend line.

Results from on-post monitoring wells are considered definitive data and are subject to data validation and verification under provisions of the CSSA Quality Assurance Project Plan (QAPP). Parsons data packages numbered 110046-#76 and -#78 containing the analytical results from this sampling event, were received by Parsons April 27 through May 1, 2017. Data validation was conducted and the data validation reports are presented in **Appendix C**.

3.2 Westbay-equipped Wells

The recently updated LTMO schedule was implemented in December 2016. In March 2017, no Westbay Well zones were scheduled for sampling. However, these wells (CS-WB01, CS-WB02, CS-WB03, and CS-WB04) were profiled to capture water level readings. These Westbay wells are located in the vicinity of AOC-65, and are part of the post-wide quarterly groundwater monitoring program. Per the recently-approved 2015 LTMO, the Upper Glen Rose (UGR)/LGR zones are to be sampled on a 15-month schedule and the BS/CC zones are sampled on a 30-month schedule. The sampling of these wells began in September 2003.

There are four other Westbay wells (CS-WB05, CS-WB06, CS-WB07, and CS-WB08) that are located at the SWMU B-3 remediation site. Those wells are sampled on a separate schedule in association with the SWMU B-3 bioreactor monitoring. Results for those wells are presented in the SWMU B-3 Performance Status Reports.

3.3 New Monitoring Well Installation

CS-MW37-LGR was installed in February 2017 to replace plugged and abandoned (P&A) off-post well LS-1. The well is 470 feet deep and screened from 445' to 470' below ground surface (bgs). On 2/7/17, drill cutting were sampled for the full list of VOC analysis. Trace amounts of ethylbenzene, m&p-xylene, and o-xylene were detected. After the dedicated QED bladder pump is installed, this well will be sampled quarterly for four consecutive quarters.

The groundwater DQOs state, each newly installed monitoring well will be sampled at the first event for the full list of VOCs, metals (arsenic, cadmium, lead, mercury, barium, chromium, copper, and zinc) and selected groundwater quality parameters (bromide, chloride, fluoride, nitrate, nitrite, sulfate, alkalinity [SW9046], TDS, pH, resistivity, alkalinity, bicarbonate [E310.1]). Subsequent monitoring events will utilize the VOC Short List only. At least four consecutive quarterly sampling events will be conducted for a newly installed monitoring well. Future sampling frequencies will be scheduled depending upon the 2015 LTMO study recommendations for the well type and data need.

4.0 MARCH 2017 SUMMARY

- Groundwater samples were collected from 3 of 4 on-post drinking water wells scheduled for monitoring in March 2017 at Camp Stanley Storage Activity (CSSA). CS-13 was not sampled due to well house construction.
- From January 1st to March 31, 2017, CSSA's AOC-65 weather station experienced equipment failure, therefore a complete set of data was not recorded. The SWMU B-3 weather station recorded 7.61 inches of rainfall. The rainfall was sporadic with 2.52 inches falling in January, 3.49 inches falling in February, and 1.60 inches in March. Three events had greater than one inch of rain at B-3.
- The Middle Trinity aquifer levels (LGR, BS, and CC) decreased an average of 8.64 feet per non-pumping well since last quarter. The average water level in March 2017 (excluding pumping wells) was 149.53 feet BTOC (1,092.02 feet MSL).
- No VOCs were detected above the MCL in March 2017 (**Table 3.3**).
- There were no metals detected above the MCL/AL/SS in the public supply wells sampled in March 2017.
- No Westbay Well zones were scheduled for sampling in March 2017. However, these wells (CS-WB01, CS-WB02, CS-WB03, and CS-WB04) were profiled to capture water level readings.
- One new monitoring well was installed on-post to fill the data gap from recently P&A well LS-1. This well will be sampled quarterly for one year then the sampling schedule will be established based on analytical results and data needs.

APPENDIX A

EVALUATION OF DATA QUALITY OBJECTIVES ATTAINMENT

Appendix A Evaluation of Data Quality Objectives Attainment

| Activity | Objectives | Action | Objective Attained? | Recommendations |
|--|--|--|--|---|
| Field Sampling | Conduct field sampling in accordance with procedures defined in the project work plan, SAP, QAPP, HSP, and LTMO recommendations. | All sampling was conducted in accordance with the procedures described in the project plans. | Yes. | NA |
| Characterization of Environmental Setting (Hydrogeology) | Prepare water-level contour and/or potentiometric maps for each formation of the Middle Trinity Aquifer (3.5.3). | Potentiometric surface maps were prepared based on water levels measured in each of CSSA's wells screened in three formations on March 24, 2017. | To the extent possible with data available. Due to the limited data available and the fact that wells are completed across multiple water-bearing units, potentiometric maps should only be used for regional water flow direction, not local. Ongoing pumping in the CSSA area likely affects the natural groundwater flow direction. | As additional wells are installed screened in distinct formations, future evaluations will eliminate reliance on wells screened across multiple formations. |
| | Describe the flow system, including the vertical and horizontal components of flow (2.1.9). | Potentiometric maps were created using March 24, 2017 water level data, and horizontal flow direction was tentatively identified. Insufficient data are currently available to determine vertical component of flow. | As described above, due to the lack of aquifer-specific water level information, potentiometric surface maps should only be used as an estimate of regional flow direction. | Same as above. |
| | Define formation(s) in the Middle Trinity Aquifer are impacted by the VOC contaminants (2.1.3). | Quarterly groundwater monitoring provides information on Middle Trinity Aquifer impacts. Monitoring wells equipped with Westbay® - multi-port samplers are sampled every 15 or 30 months. | Yes. | Continue sampling. |

| Activity | Objectives | Action | Objective Attained? | Recommendations |
|--|---|--|--|---|
| Characterization of Environmental Setting (Hydrogeology) (Continued) | Identify any temporal changes in hydraulic gradients due to seasonal influences (2.1.5). | Downloaded data from continuous-reading transducers in wells: CS-MW4-LGR, CS-MW9-LGR, CS-MW12-LGR, CS-MW12-CC, and CS-MW10-CC. Additional continuous reading transducers were added to the program through the SCADA project. The following wells can be uploaded to see real time water level data: CS-MW16-LGR, CS-MW16-CC, CS-1, CS-12, and CS-10. Data was also downloaded from the AOC-65 and B-3 weather stations. Water levels will be graphed at these wells against precipitation data through December 2017 and included in the annual groundwater report. | Yes. | Continue collection of transducer data and possibly install transducers in other cluster wells. |
| Contamination Characterization (Ground Water Contamination) | Characterize the horizontal and vertical extent of any immiscible or dissolved plume(s) originating from the Facility (3.1.2). | Samples for laboratory analysis were collected from 3 of 4 CSSA on-post drinking water wells. The 4 BS wells are no longer sampled as part of the groundwater program. | The horizontal and vertical extent of groundwater contamination is continuously monitored. | Continue groundwater monitoring and construct additional wells as necessary. |
| | Determine the horizontal and vertical concentration profiles of all constituents of concern (COC) in the groundwater that are measured by USEPA-approved procedures (3.1.2). COCs are those chemicals that have been detected in groundwater in the past and their daughter (breakdown) products. | Groundwater samples were collected from wells: CS-1, CS-10, and CS-12. Samples were analyzed for the short list of VOCs using USEPA method SW8260B. These drinking water wells were also sampled for metals (arsenic, barium, chromium, copper, cadmium, mercury, lead, and zinc). Analyses were conducted in accordance with the CSSA QAPP and approved variances. All reporting limits (RL) were below MCLs, as listed below: | Yes. | Continue sampling. |

| Activity | Objectives | Action | Objective Attained? | Recommendations | | | | | | | | | | | | | | | | | | | | | | | | | |
|--|---|---|---------------------|-----------------|-----------|---------------------|----------|----|-----|--------|----|-------|------|----|----------------|---------|----|------|--------------------|---|---|------|----|----|---------|---|---|------|--------------------|
| Contamination Characterization (Ground Water Contamination) (Continued) | Determine the horizontal and vertical concentration profiles of all constituents of concern (COC) in the groundwater that are measured by USEPA-approved procedures (3.1.2). COCs are those chemicals that have been detected in groundwater in the past and their daughter (breakdown) products. | <table border="1"> <thead> <tr> <th data-bbox="617 347 793 370">ANALYTE</th> <th data-bbox="800 347 961 370">RL (µg/L)</th> <th data-bbox="968 347 1131 370">MCL(µg/L)</th> </tr> </thead> <tbody> <tr> <td data-bbox="617 370 793 393"><i>cis</i>-1,2-DCE</td> <td data-bbox="800 370 961 393">1.2</td> <td data-bbox="968 370 1131 393">70</td> </tr> <tr> <td data-bbox="617 393 793 415">PCE</td> <td data-bbox="800 393 961 415">1.4</td> <td data-bbox="968 393 1131 415">5</td> </tr> <tr> <td data-bbox="617 415 793 438">TCE</td> <td data-bbox="800 415 961 438">1.0</td> <td data-bbox="968 415 1131 438">5</td> </tr> <tr> <td data-bbox="617 438 793 461">Vinyl chloride</td> <td data-bbox="800 438 961 461">1.1</td> <td data-bbox="968 438 1131 461">2</td> </tr> </tbody> </table> | ANALYTE | RL (µg/L) | MCL(µg/L) | <i>cis</i> -1,2-DCE | 1.2 | 70 | PCE | 1.4 | 5 | TCE | 1.0 | 5 | Vinyl chloride | 1.1 | 2 | Yes. | Continue sampling. | | | | | | | | | | |
| | | ANALYTE | RL (µg/L) | MCL(µg/L) | | | | | | | | | | | | | | | | | | | | | | | | | |
| | <i>cis</i> -1,2-DCE | 1.2 | 70 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | PCE | 1.4 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| TCE | 1.0 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Vinyl chloride | 1.1 | 2 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| <table border="1"> <thead> <tr> <th data-bbox="617 561 793 584">ANALYTE</th> <th data-bbox="800 561 961 584">RL (µg/L)</th> <th data-bbox="968 561 1131 584">MCL/AL (µg/L)</th> </tr> </thead> <tbody> <tr> <td data-bbox="617 584 793 607">Barium</td> <td data-bbox="800 584 961 607">5</td> <td data-bbox="968 584 1131 607">2,000</td> </tr> <tr> <td data-bbox="617 607 793 630">Chromium</td> <td data-bbox="800 607 961 630">10</td> <td data-bbox="968 607 1131 630">100</td> </tr> <tr> <td data-bbox="617 630 793 652">Copper</td> <td data-bbox="800 630 961 652">10</td> <td data-bbox="968 630 1131 652">1,300</td> </tr> <tr> <td data-bbox="617 652 793 675">Zinc</td> <td data-bbox="800 652 961 675">50</td> <td data-bbox="968 652 1131 675">5,000</td> </tr> <tr> <td data-bbox="617 675 793 698">Arsenic</td> <td data-bbox="800 675 961 698">30</td> <td data-bbox="968 675 1131 698">10</td> </tr> <tr> <td data-bbox="617 698 793 721">Cadmium</td> <td data-bbox="800 698 961 721">7</td> <td data-bbox="968 698 1131 721">5</td> </tr> <tr> <td data-bbox="617 721 793 743">Lead</td> <td data-bbox="800 721 961 743">25</td> <td data-bbox="968 721 1131 743">15</td> </tr> <tr> <td data-bbox="617 743 793 766">Mercury</td> <td data-bbox="800 743 961 766">1</td> <td data-bbox="968 743 1131 766">2</td> </tr> </tbody> </table> | ANALYTE | RL (µg/L) | MCL/AL (µg/L) | Barium | 5 | 2,000 | Chromium | 10 | 100 | Copper | 10 | 1,300 | Zinc | 50 | 5,000 | Arsenic | 30 | 10 | Cadmium | 7 | 5 | Lead | 25 | 15 | Mercury | 1 | 2 | Yes. | Continue sampling. |
| ANALYTE | RL (µg/L) | MCL/AL (µg/L) | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Barium | 5 | 2,000 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Chromium | 10 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Copper | 10 | 1,300 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Zinc | 50 | 5,000 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Arsenic | 30 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Cadmium | 7 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Lead | 25 | 15 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Mercury | 1 | 2 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Meet CSSA QAPP quality assurance requirements. | Samples were analyzed in accordance with the CSSA QAPP and approved variances. Parsons chemists verified all data. | Yes. | NA | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | All data flagged with a “U,” “J,” “M,” and “F” are usable for characterizing contamination. All “R” flagged data are considered unusable. | Yes. | NA | | | | | | | | | | | | | | | | | | | | | | | | | | |

| Activity | Objectives | Action | Objective Attained? | Recommendations |
|---|---|---|---|--|
| Contamination Characterization (Ground Water Contamination) (Continued) | Meet CSSA QAPP quality assurance requirements. (Continued) | Previously, a method detection limit (MDL) study for arsenic, cadmium, and lead was not performed within a year of the analyses, as required by the AFCEE QAPP. | The laboratory performed new MDL studies in February 2001 for these metals and the new MDL values were found to be almost identical to the previous MDLs and all met the associated AFCEE QAPP requirements. MDLs for these three metals are well below MCLs. In addition, the laboratory performed daily calibrations and RL verifications for these metals, both of which demonstrate the laboratory's ability to detect and quantitate these metals at RL levels. These daily analyses also indicate that concentrations above the laboratory RL for these compounds were not affected by the expired MDL study. | Use results for groundwater characterization purposes. |
| Remediation | Determine goals and create cost-effective and technologically appropriate methods for remediation (2.2.1). | Continued data collection will provide analytical results for accomplishing this objective. | Ongoing. | Continue sampling and evaluation, including quarterly groundwater monitoring teleconferences to address remediation. |
| Remediation | Determine placement of new wells for monitoring (2.3.1, 3.6) | Sampling frequency and sample locations to be monitored (including any new wells) will be based on trend data from monitoring event(s) (3.1.5). | Ongoing. | Continue quarterly groundwater teleconferences to discuss sampling frequency and placement of new monitor wells. |
| Project schedule/ Reporting | Produce a quarterly monitoring project schedule as a road map for sampling, analysis, validation, verification, reviews, and reports. | Prepare schedules and sampling guidelines prior to each quarterly sampling event. | Yes. | Continue sampling schedule preparation each quarter. |

APPENDIX B

**QUARTERLY ON-POST GROUNDWATER
MONITORING ANALYTICAL RESULTS
MARCH 2017**

Appendix B
Quarterly On-Post Groundwater Monitoring Analytical Results, March 2017

| Well ID | Sample Date | Arsenic | Barium | Cadmium | Chromium | Copper | Lead | Zinc | Mercury |
|--|-------------|----------------|---------------|---------|----------------|---------------|---------|---------------|---------|
| CSSA Drinking Water Well System | | | | | | | | | |
| CS-1 | 4/4/2017 | 0.0066F | 0.0366 | 0.0005U | 0.0010U | 0.005F | 0.0019U | 0.191 | 0.0001U |
| CS-10 | 3/30/2017 | 0.0054F | 0.0396 | 0.0005U | 0.0013F | 0.011 | 0.0019U | 0.227 | 0.0001U |
| CS-12 | 3/30/2017 | 0.0023F | 0.0291 | 0.0005U | 0.0012F | 0.003U | 0.0019U | 0.028F | 0.0001U |
| CS-12 FD | 3/30/2017 | 0.0013F | 0.0284 | 0.0005U | 0.0010U | 0.003U | 0.0019U | 0.025F | 0.0001U |

| Well ID | Sample Date | cis-1,2-DCE | PCE | TCE | Vinyl Chloride |
|--|-------------|-------------|--------------|-------|----------------|
| CSSA Drinking Water Well System | | | | | |
| CS-1 | 4/4/2017 | 0.07U | 0.06U | 0.05U | 0.08U |
| CS-10 | 3/30/2017 | 0.07U | 0.18F | 0.05U | 0.08U |
| CS-12 | 3/30/2017 | 0.07U | 0.28F | 0.05U | 0.08U |
| CS-12 FD | 3/30/2017 | 0.07U | 0.19F | 0.05U | 0.08U |

| | |
|-------------|-----------------|
| BOLD | = Above the MDL |
| BOLD | = Above the RL |
| BOLD | = Above the MCL |

All samples were analyzed by APPL, Inc.
 VOC data reported in ug/L & metals data reported in mg/L.

Abbreviations/Notes:

FD Field Duplicate
 TCE Trichloroethene
 PCE Tetrachloroethene
 DCE Dichloroethene

Data Qualifiers

U-The analyte was analyzed for, but not detected. The associated numerical value is at or below the MDL.
 F-The analyte was positively identified but the associated numerical value is below the RL.

APPENDIX C
DATA VALIDATION REPORT

SDG 82553
SDG 82595

DATA VERIFICATION SUMMARY REPORT

for on-post samples collected from CAMP STANLEY STORAGE ACTIVITY

BOERNE, TEXAS

Data Verification by: Tammy Chang
Parsons - Austin

INTRODUCTION

The following data verification summary report covers two groundwater samples and the associated field quality control (QC) samples collected from on-post Camp Stanley Storage Activity (CSSA) on March 30, 2017. The samples were assigned to the following Sample Delivery Group (SDG). All samples were analyzed for volatile organic compounds (VOCs) and selected metals which include arsenic, barium, cadmium, chromium, copper, lead, zinc, and mercury.

82553

The field QC sample associated with this SDG were one trip blank (TB) sample and one set of parent/field duplicate (FD) samples. No ambient blanks were collected. During the initiation of this project, it was determined that ambient blanks were not necessary due to the absence of a source at these sites.

All samples were collected by Parsons and analyzed by APPL, Inc. following the procedures outlined in the Statement of Work and CSSA QAPP, Version 1.0. Samples in this SDG were shipped to the laboratory in one cooler. Cooler was received by the laboratory at a temperature of 4.5°C, which was within the 2-6°C range recommended by the CSSA QAPP.

EVALUATION CRITERIA

The data submitted by the laboratory has been reviewed and verified following the guidelines outlined in the CSSA QAPP, Version 1.0. Information reviewed in the data package included sample results; field and laboratory quality control samples; calibrations; case narratives; raw data; chain-of-custody (COC) forms and the sample receipt checklist. The findings presented in this report are based on the reviewed information, and whether the guidelines in the CSSA QAPP, Version 1.0, were met.

VOLATILES

General

The volatiles portion of this data package consisted of two (2) on-post groundwater samples, one FD, and one (1) TB. All samples were collected on March 30, 2017 and analyzed for a reduced list of VOCs which included: *cis*-1,2-dichloroethene, tetrachloroethene, trichloroethene, and vinyl chloride.

The VOC analyses were performed using United States Environmental Protection Agency (USEPA) SW846 Method 8260B. The samples were analyzed in one analytical batch, #217665 under one initial calibration curve (ICAL) with the same instrument. Both samples were analyzed following the procedures outlined in the CSSA QAPP and were prepared and analyzed within the holding time required by the method. All analyses were performed undiluted.

Accuracy

Accuracy was evaluated using the percent recovery (%R) obtained from laboratory control spike (LCS) sample and the surrogate spikes.

All LCS, MS, MSD, and surrogate spike recoveries were within acceptance criteria.

Precision

Precision was evaluated based on relative percent difference (%RPD) of the parent and FD concentration. Sample CS-12 was collected in duplicate.

None of the target analytes was detected above the reporting limits (RLs), therefore, the %RPD calculation was not applicable.

Representativeness

Representativeness expresses the degree to which sample data accurately and precisely represents actual site conditions. Representativeness has been evaluated by:

- Comparing the COC procedures to those described in the CSSA QAPP;
- Comparing actual analytical procedures to those described in the CSSA QAPP;
- Evaluating holding times; and
- Examining laboratory blank and trip blank for cross contamination of samples during analysis and transportation.

All samples in this data package were analyzed following the COC and the analytical procedures described in the CSSA QAPP, Version 1.0. All samples were prepared and analyzed within the holding time required by the method.

- All instrument performance check criteria were met.
- All initial calibration criteria were met for both sets of curves.
- All initial calibration verification (ICV) criteria were met. The ICV was prepared using a secondary source standard. All second source verification criteria were met.
- All continuing calibration verification (CCV) criteria were met.
- All internal standard criteria were met.

There was one method blank and one TB associated with the VOC analyses in this SDG. Both blanks were non-detect at method detection limits for all target VOCs.

Completeness

Completeness has been evaluated in accordance with the CSSA QAPP. The number of usable results has been divided by the number of possible individual analyte results and expressed as a percentage to determine the completeness of the data set.

All VOC results for the samples in this SDG were considered usable. The completeness for this SDG is 100%, which meets the minimum acceptance criteria of 95%.

ICP-AES METALS

General

The ICP-AES portion of this SDG consisted of two (2) on-post groundwater sample and one (1) FD. All samples were collected on March 30, 2017. All samples were analyzed for arsenic, barium, cadmium, chromium, copper, lead, and zinc.

The ICP-AES metals analyses were performed using USEPA SW846 Method 6010B. All samples were analyzed following the procedures outlined in the CSSA QAPP and were prepared and analyzed within the holding time required by the method.

The samples for ICP-AES metals were digested in batch #218188. All analyses were performed undiluted.

Accuracy

Accuracy was evaluated using the percent recovery obtained from the LCS.

All LCS recoveries were within acceptance criteria.

Precision

Precision was measured based on the %RPD of parent/FD results. Sample CS-12 was collected in duplicate.

Only barium was detected above the RL and its %RPD was compliant.

Representativeness

Representativeness expresses the degree to which sample data accurately and precisely represents actual site conditions. Representativeness has been evaluated by:

- Comparing the COC procedures to those described in the CSSA QAPP;
- Comparing actual analytical procedures to those described in the CSSA QAPP;
- Evaluating preservation and holding times; and
- Examining laboratory blank for cross contamination of samples during analysis.

All samples were analyzed following the COC and the analytical procedures described in the CSSA QAPP, Version 1.0, prepared and analyzed within the holding time required by the method.

- All initial calibration criteria were met.

- All second source verification criteria were met. The ICV was prepared using a secondary source.
- All CCV criteria were met.
- All interference check (ICSA/ICSAB) criteria were met.
- No dilution test was required, as per the CSSA QAPP.

One method blank and several calibration blanks were analyzed in association with the ICP-AES analyses in this SDG. All blanks were free of target metals at or above the RL.

Completeness

Completeness has been evaluated by comparing the total number of samples collected with the total number of samples with valid analytical data.

All ICP-AES metals results for the samples in this SDG were considered usable. The completeness for the ICP metals portion of this SDG is 100%, which meets the minimum acceptance criteria of 95%.

MERCURY

General

The mercury portion of this SDG consisted of two (2) on-post groundwater sample and one (1) FD. All samples were collected on March 30, 2017 and were analyzed for mercury.

The mercury analyses were performed using USEPA SW846 Method 7470A. These samples were analyzed following the procedures outlined in the CSSA QAPP, prepared and analyzed within the holding time required by the method.

The mercury samples were prepared in batch #218197. The analyses were performed undiluted.

Accuracy

Accuracy was evaluated using the %R obtained from the LCS analyses.

The LCS has a compliant %R.

Precision

Precision was measured based on the %RPD of parent/FD results. CS-12 was collected in duplicate.

Mercury was not detected in the parent/FD samples, therefore, the %RPD cannot be calculated.

Representativeness

Representativeness expresses the degree to which sample data accurately and precisely represents actual site conditions. Representativeness has been evaluated by:

- Comparing the COC procedures to those described in the CSSA QAPP;
- Comparing actual analytical procedures to those described in the CSSA QAPP;
- Evaluating holding times; and
- Examining laboratory blanks for cross contamination of samples during analysis.

All samples were analyzed following the COC and the analytical procedures described in the CSSA QAPP, prepared and analyzed within the holding times required by the method.

- All initial calibration criteria were met.
- All second source verification criteria were met. The ICV was prepared using a secondary source.
- All calibration verification criteria were met.

There was one method blank and several calibration blanks associated with the mercury analyses in this SDG. All blanks were free of mercury at or above the RL.

Completeness

Completeness has been evaluated by comparing the total number of samples collected with the total number of samples with valid analytical data.

Mercury result for the samples in this SDG was considered usable. The completeness for the mercury portion of this SDG is 100%, which meets the minimum acceptance criteria of 90%.

DATA VERIFICATION SUMMARY REPORT

for on-post samples collected from CAMP STANLEY STORAGE ACTIVITY

BOERNE, TEXAS

Data Verification by: Tammy Chang
Parsons - Austin

INTRODUCTION

The following data verification summary report covers one groundwater sample and the associated field quality control (QC) samples collected from on-post Camp Stanley Storage Activity (CSSA) on April 4th, 2017. The samples were assigned to the following Sample Delivery Group (SDG). All samples were analyzed for volatile organic compounds (VOCs) and selected metals which include arsenic, barium, cadmium, chromium, copper, lead, zinc, and mercury.

82595

The field QC sample associated with this SDG were one trip blank (TB) sample and one set of matrix spike/matrix spike duplicate (MS/MSD) samples. No ambient blanks were collected. During the initiation of this project, it was determined that ambient blanks were not necessary due to the absence of a source at these sites.

All samples were collected by Parsons and analyzed by APPL, Inc. following the procedures outlined in the Statement of Work and CSSA QAPP, Version 1.0. Samples in this SDG were shipped to the laboratory in one cooler. Cooler was received by the laboratory at a temperature of 3.0 °C, which was within the 2-6°C range recommended by the CSSA QAPP.

EVALUATION CRITERIA

The data submitted by the laboratory has been reviewed and verified following the guidelines outlined in the CSSA QAPP, Version 1.0. Information reviewed in the data package included sample results; field and laboratory quality control samples; calibrations; case narratives; raw data; chain-of-custody (COC) forms and the sample receipt checklist. The findings presented in this report are based on the reviewed information, and whether the guidelines in the CSSA QAPP, Version 1.0, were met.

VOLATILES

General

The volatiles portion of this data package consisted of one (1) on-post groundwater sample, one set of MS/MSD, and one (1) TB. All samples were collected on April 4th, 2017 and analyzed for a reduced list of VOCs which included: *cis*-1,2-dichloroethene, tetrachloroethene, trichloroethene, and vinyl chloride.

The VOC analyses were performed using United States Environmental Protection Agency (USEPA) SW846 Method 8260B. The samples were analyzed in one analytical batch, #217969 under one initial calibration curve (ICAL) with the same instrument. Both samples were analyzed following the procedures outlined in the CSSA QAPP and were prepared and analyzed within the holding time required by the method. All analyses were performed undiluted.

Accuracy

Accuracy was evaluated using the percent recovery (%R) obtained from laboratory control spike (LCS) sample, MS/MSD, and the surrogate spikes. Sample CS-1 was designated as the parent sample for the MS/MSD analyses.

All LCS, MS, MSD, and surrogate spike recoveries were within acceptance criteria.

Precision

Precision was evaluated based on relative percent difference (%RPD) of the MS and MSD concentration.

All %RPDs were compliant except Vinyl Chloride had %RPD greater than the criteria of 20%RPD. Since this compound was not detected in the parent sample, no flag was applied.

Representativeness

Representativeness expresses the degree to which sample data accurately and precisely represents actual site conditions. Representativeness has been evaluated by:

- Comparing the COC procedures to those described in the CSSA QAPP;
- Comparing actual analytical procedures to those described in the CSSA QAPP;
- Evaluating holding times; and
- Examining laboratory blank and trip blank for cross contamination of samples during analysis and transportation.

All samples in this data package were analyzed following the COC and the analytical procedures described in the CSSA QAPP, Version 1.0. All samples were prepared and analyzed within the holding time required by the method.

- All instrument performance check criteria were met.
- All initial calibration criteria were met for both sets of curves.
- All initial calibration verification (ICV) criteria were met. The ICV was prepared using a secondary source standard. All second source verification criteria were met.
- All continuing calibration verification (CCV) criteria were met.
- All internal standard criteria were met.

There was one method blank and one TB associated with the VOC analyses in this SDG. Both blanks were non-detect at method detection limits for all target VOCs.

Completeness

Completeness has been evaluated in accordance with the CSSA QAPP. The number of usable results has been divided by the number of possible individual analyte results and expressed as a percentage to determine the completeness of the data set.

All VOC results for the samples in this SDG were considered usable. The completeness for this SDG is 100%, which meets the minimum acceptance criteria of 95%.

ICP-AES METALS

General

The ICP-AES portion of this SDG consisted of one (1) on-post groundwater sample and one set of MS/MSD. All samples were collected on April 4, 2017. All samples were analyzed for arsenic, barium, cadmium, chromium, copper, lead, and zinc.

The ICP-AES metals analyses were performed using USEPA SW846 Method 6010B. All samples were analyzed following the procedures outlined in the CSSA QAPP and were prepared and analyzed within the holding time required by the method.

The samples for ICP-AES metals were digested in batch #218294. All analyses were performed undiluted.

Accuracy

Accuracy was evaluated using the percent recovery obtained from the LCS, MS and MSD. CS-1 was designated as the parent sample for the MS/MSD analyses.

All LCS, MS, and MSD recoveries were within acceptance criteria.

Precision

Precision was measured based on the %RPD of MS/MSD results.

All %RPDs were compliant.

Representativeness

Representativeness expresses the degree to which sample data accurately and precisely represents actual site conditions. Representativeness has been evaluated by:

- Comparing the COC procedures to those described in the CSSA QAPP;
- Comparing actual analytical procedures to those described in the CSSA QAPP;
- Evaluating preservation and holding times; and
- Examining laboratory blank for cross contamination of samples during analysis.

All samples were analyzed following the COC and the analytical procedures described in the CSSA QAPP, Version 1.0, prepared and analyzed within the holding time required by the method.

- All initial calibration criteria were met.
- All second source verification criteria were met. The ICV was prepared using a secondary source.
- All CCV criteria were met.
- All interference check (ICSA/ICSAB) criteria were met.
- No dilution test was required, as per the CSSA QAPP.

One method blank and several calibration blanks were analyzed in association with the ICP-AES analyses in this SDG. All blanks were free of target metals at or above the RL.

Completeness

Completeness has been evaluated by comparing the total number of samples collected with the total number of samples with valid analytical data.

All ICP-AES metals results for the samples in this SDG were considered usable. The completeness for the ICP metals portion of this SDG is 100%, which meets the minimum acceptance criteria of 95%.

MERCURY

General

The mercury portion of this SDG consisted of one (1) on-post groundwater sample and one (1) set of MS/MSD. All samples were collected on April 4, 2017 and were analyzed for mercury.

The mercury analyses were performed using USEPA SW846 Method 7470A. These samples were analyzed following the procedures outlined in the CSSA QAPP, prepared and analyzed within the holding time required by the method.

The mercury samples were prepared in batch #218039. The analyses were performed undiluted.

Accuracy

Accuracy was evaluated using the %R obtained from the LCS, MS, and MSD analyses. CS-1 was designated as the parent sample for the MS/MSD analyses.

The LCS, MS, and MSD recovery were within acceptance criteria.

Precision

Precision was measured based on the %RPD of MS/MSD results.

The %RPD of MS/MSD was compliant.

Representativeness

Representativeness expresses the degree to which sample data accurately and precisely represents actual site conditions. Representativeness has been evaluated by:

- Comparing the COC procedures to those described in the CSSA QAPP;
- Comparing actual analytical procedures to those described in the CSSA QAPP;
- Evaluating holding times; and
- Examining laboratory blanks for cross contamination of samples during analysis.

All samples were analyzed following the COC and the analytical procedures described in the CSSA QAPP, prepared and analyzed within the holding times required by the method.

- All initial calibration criteria were met.
- All second source verification criteria were met. The ICV was prepared using a secondary source.
- All calibration verification criteria were met.

There was one method blank and several calibration blanks associated with the mercury analyses in this SDG. All blanks were free of mercury at or above the RL.

Completeness

Completeness has been evaluated by comparing the total number of samples collected with the total number of samples with valid analytical data.

Mercury result for the sample in this SDG was considered usable. The completeness for the mercury portion of this SDG is 100%, which meets the minimum acceptance criteria of 90%.

APPENDIX D

CS-MW37-LGR ANALYTICAL DATA

AFCEE
ORGANIC ANALYSES DATA SHEET 2
RESULTS

Analytical Method: EPA 8260B Preparatory Method: 5035 AAB #: 170209AL-216082
 Lab Name: APPL, Inc Contract #: *G012
 Field Sample ID: CS-MW37-CUTT Lab Sample ID: AZ49673 Matrix: Soil
 % Solids: 88.2 Initial Calibration ID: 170209
 Date Received: 09-Feb-17 Date Prepared: 09-Feb-17 Date Analyzed: 09-Feb-17
 Concentration Units: mg/kg

| Analyte | MDL | RL | Concentration | Dilution | Confirm | Qualifier |
|-----------------------------|--------|-------|---------------|----------|---------|-----------|
| 1,1,1,2-TETRACHLOROETHANE | 0.0009 | 0.003 | 0.0009 | 1 | | U |
| 1,1,1-TCA | 0.0010 | 0.004 | 0.0010 | 1 | | U |
| 1,1,2,2-TETRACHLOROETHANE | 0.0010 | 0.002 | 0.0010 | 1 | | U |
| 1,1,2-TCA | 0.0010 | 0.006 | 0.0010 | 1 | | U |
| 1,1-DCA | 0.0011 | 0.002 | 0.0011 | 1 | | U |
| 1,1-DCE | 0.0012 | 0.007 | 0.0012 | 1 | | U |
| 1,1-DICHLOROPROPENE | 0.0014 | 0.006 | 0.0014 | 1 | | U |
| 1,2,3-TRICHLOROBENZENE | 0.0011 | 0.004 | 0.0011 | 1 | | U |
| 1,2,3-TRICHLOROPROPANE | 0.001 | 0.023 | 0.001 | 1 | | U |
| 1,2,4-TRICHLOROBENZENE | 0.0011 | 0.004 | 0.0011 | 1 | | U |
| 1,2,4-TRIMETHYLBENZENE | 0.0012 | 0.008 | 0.0012 | 1 | | U |
| 1,2-DCA | 0.0011 | 0.003 | 0.0011 | 1 | | U |
| 1,2-DCB | 0.0011 | 0.002 | 0.0011 | 1 | | U |
| 1,2-DIBROMO-3-CHLOROPROPANE | 0.002 | 0.011 | 0.002 | 1 | | U |
| 1,2-DICHLOROPROPANE | 0.0008 | 0.002 | 0.0008 | 1 | | U |
| 1,2-EDB | 0.0015 | 0.003 | 0.0015 | 1 | | U |
| 1,3,5-TRIMETHYLBENZENE | 0.0012 | 0.003 | 0.0012 | 1 | | U |
| 1,3-DCB | 0.0012 | 0.007 | 0.0012 | 1 | | U |
| 1,3-DICHLOROPROPANE | 0.0008 | 0.002 | 0.0008 | 1 | | U |
| 1,4-DCB | 0.0009 | 0.002 | 0.0009 | 1 | | U |
| 1-CHLOROHEXANE | 0.0010 | 0.003 | 0.0010 | 1 | | U |
| 2,2-DICHLOROPROPANE | 0.001 | 0.023 | 0.001 | 1 | | U |
| 2-CHLOROTOLUENE | 0.0015 | 0.002 | 0.0015 | 1 | | U |
| 4-CHLOROTOLUENE | 0.0012 | 0.003 | 0.0012 | 1 | | U |
| BENZENE | 0.0010 | 0.002 | 0.0010 | 1 | | U |
| BROMOBENZENE | 0.0010 | 0.002 | 0.0010 | 1 | | U |
| BROMOCHLOROMETHANE | 0.0009 | 0.002 | 0.0009 | 1 | | U |
| BROMODICHLOROMETHANE | 0.0010 | 0.004 | 0.0010 | 1 | | U |
| BROMOFORM | 0.0012 | 0.007 | 0.0012 | 1 | | U |
| BROMOMETHANE | 0.0008 | 0.006 | 0.0008 | 1 | | U |
| CARBON TETRACHLORIDE | 0.001 | 0.011 | 0.001 | 1 | | U |
| CHLOROBENZENE | 0.0008 | 0.002 | 0.0008 | 1 | | U |
| CHLOROETHANE | 0.0017 | 0.006 | 0.0017 | 1 | | U |
| CHLOROFORM | 0.0008 | 0.002 | 0.0008 | 1 | | U |
| CHLOROMETHANE | 0.0017 | 0.008 | 0.0017 | 1 | | U |
| CIS-1,2-DCE | 0.0009 | 0.007 | 0.0009 | 1 | | U |
| CIS-1,3-DICHLOROPROPENE | 0.0010 | 0.006 | 0.0010 | 1 | | U |

Comments: ARF: 82120 The RL and MDL were Moisture Corrected on this form.

AFCEE
ORGANIC ANALYSES DATA SHEET 2
RESULTS

Analytical Method: EPA 8260B Preparatory Method: 5035 AAB #: 170209AL-216082
 Lab Name: APPL, Inc Contract #: *G012
 Field Sample ID: CS-MW37-CUTT Lab Sample ID: AZ49673 Matrix: Soil
 % Solids: 88.2 Initial Calibration ID: 170209
 Date Received: 09-Feb-17 Date Prepared: 09-Feb-17 Date Analyzed: 09-Feb-17
 Concentration Units: mg/kg

| Analyte | MDL | RL | Concentration | Dilution | Confirm | Qualifier |
|---------------------------|--------|-------|---------------|----------|---------|-----------|
| DIBROMOCHLOROMETHANE | 0.0010 | 0.003 | 0.0010 | 1 | | U |
| DIBROMOMETHANE | 0.001 | 0.011 | 0.001 | 1 | | U |
| DICHLORODIFLUOROMETHANE | 0.0020 | 0.006 | 0.0020 | 1 | | U |
| ETHYLBENZENE | 0.0011 | 0.003 | 0.0019 | 1 | | F |
| HEXACHLOROBUTADIENE | 0.0012 | 0.006 | 0.0012 | 1 | | U |
| ISOPROPYLBENZENE | 0.0011 | 0.009 | 0.0011 | 1 | | U |
| M&P-XYLENE | 0.0020 | 0.008 | 0.0067 | 1 | | F |
| METHYLENE CHLORIDE | 0.0015 | 0.006 | 0.0015 | 1 | | U |
| N-BUTYLBENZENE | 0.0011 | 0.006 | 0.0011 | 1 | | U |
| N-PROPYLBENZENE | 0.0014 | 0.002 | 0.0014 | 1 | | U |
| NAPHTHALENE | 0.0011 | 0.023 | 0.0011 | 1 | | U |
| O-XYLENE | 0.0008 | 0.006 | 0.0033 | 1 | | F |
| P-ISOPROPYLTOLUENE | 0.0014 | 0.007 | 0.0014 | 1 | | U |
| SEC-BUTYLBENZENE | 0.0012 | 0.008 | 0.0012 | 1 | | U |
| STYRENE | 0.0010 | 0.002 | 0.0010 | 1 | | U |
| TCE | 0.0014 | 0.011 | 0.0014 | 1 | | U |
| TERT-BUTYLBENZENE | 0.0014 | 0.008 | 0.0014 | 1 | | U |
| TETRACHLOROETHENE | 0.0009 | 0.008 | 0.0009 | 1 | | U |
| TOLUENE | 0.0011 | 0.006 | 0.0011 | 1 | | U |
| TRANS-1,2-DCE | 0.0009 | 0.003 | 0.0009 | 1 | | U |
| TRANS-1,3-DICHLOROPROPENE | 0.0010 | 0.006 | 0.0010 | 1 | | U |
| TRICHLOROFLUOROMETHANE | 0.0015 | 0.004 | 0.0015 | 1 | | U |
| VINYL CHLORIDE | 0.0015 | 0.010 | 0.0015 | 1 | | U |

| Surrogate | Recovery | Control Limits | Qualifier |
|--------------------------------|----------|----------------|-----------|
| SURROGATE: 1,2-DICHLOROETHANE- | 98.7 | 52-149 | |
| SURROGATE: 4-BROMOFLUOROBEN | 101 | 65-135 | |
| SURROGATE: DIBROMOFLUOROMET | 101 | 65-135 | |
| SURROGATE: TOLUENE-D8 (S) | 97.8 | 65-135 | |

| Internal Std | Qualifier |
|-----------------------------|-----------|
| 1,4-DICHLOROBENZENE-D4 (IS) | |
| CHLOROBENZENE-D5 (IS) | |
| FLUOROBENZENE (IS) | |

Comments: ARF: 82120 The RL and MDL were Moisture Corrected on this form.

AFCEE
WET CHEM ANALYSES DATA SHEET 2
RESULTS

Analytical Method: CLP MOIST

AAB #: A170209-216067

Lab Name: APPL, Inc

Contract #: *G012

Field Sample ID: CS-MW37-CUTT

Lab Sample ID: AZ49673

Matrix: Soil

% Solids: 88.2

Date Received: 09-Feb-17

Date Prepared: 09-Feb-17

Date Analyzed: 10-Feb-17

Concentration Units: %

| Analyte | MDL | RL | Concentration | Dilution | Qualifier |
|----------|-----|-----|---------------|----------|-----------|
| MOISTURE | | 2.0 | 11.8 | 1 | |

Comments: ARF: 82120
